




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written permission of ABB Network Partner AB is strictly forbidden.

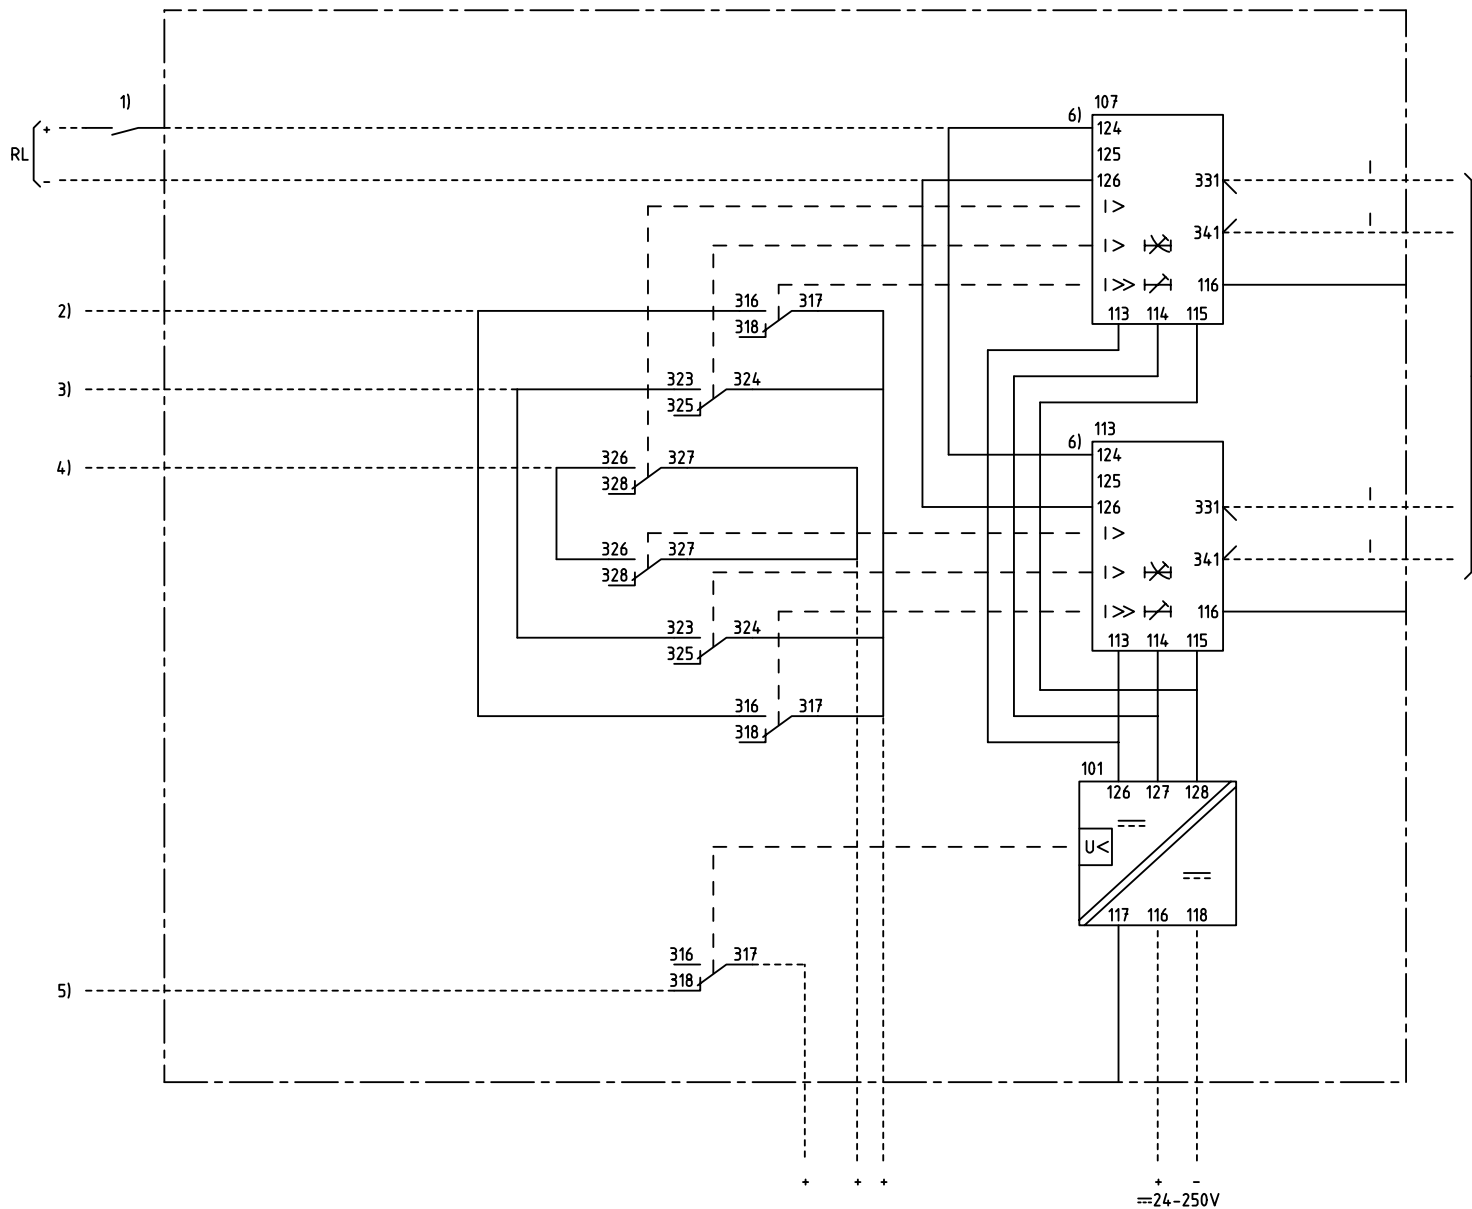

2-PHASE OVERCURRENT PROTECTION  
2-FAS ÖVERSTRÖMSKYDD



101 RXTUG 22H  
107,113 RXIDK 2H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE  
FRIGIVNING, BLOCKERING ELLER ÖKAT  
FUNKTIONSVÄRDE
- 2) HIGH SET STAGE, TRIPPING  
HÖGSTRÖMSSTEG, UTLÖSNING
- 3) LOW SET STAGE, TRIPPING  
LÅGSTRÖMSSTEG, UTLÖSNING
- 4) LOW SET STAGE, START  
LÅGSTRÖMSSTEG, START
- 5) LOSS OF AUXILIARY RELAY  
BORTFALL AV HJÄLPSPÄNNING
- 6) CONNECTED FOR RL=110-220V DC  
CHANGE FROM 124 TO 125  
AT RL=48-60V DC  
KOPPLAD FÖR RL=110-220V DC  
ÄNDRA FRÅN 124 TO 125  
VID RL=48-60V DC

ELCAD ID PS/render      DATE 2004-06-232:59      1MRK 001002-HA      Issued in ARCADE

Prepared 96-10-25		C-H EINVALL/LB		CIRCUIT DIAGRAM/KRETSSCHEMA			
Approved 96-11-18		P JENÄKER		RAIDK 2 OVERCURRENT PROTECTION			
				RAIDK 2 ÖVERSTRÖMSKYDD		Resp dep PS    Rev ind 1 97.17    Lang 82	
Rev Ind	Revision	Reg No	7411	<b>ABB</b> ABB Network Partner AB		<b>1MRK 001 003-HA</b>	
Based on		Pcl	890 474				