




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

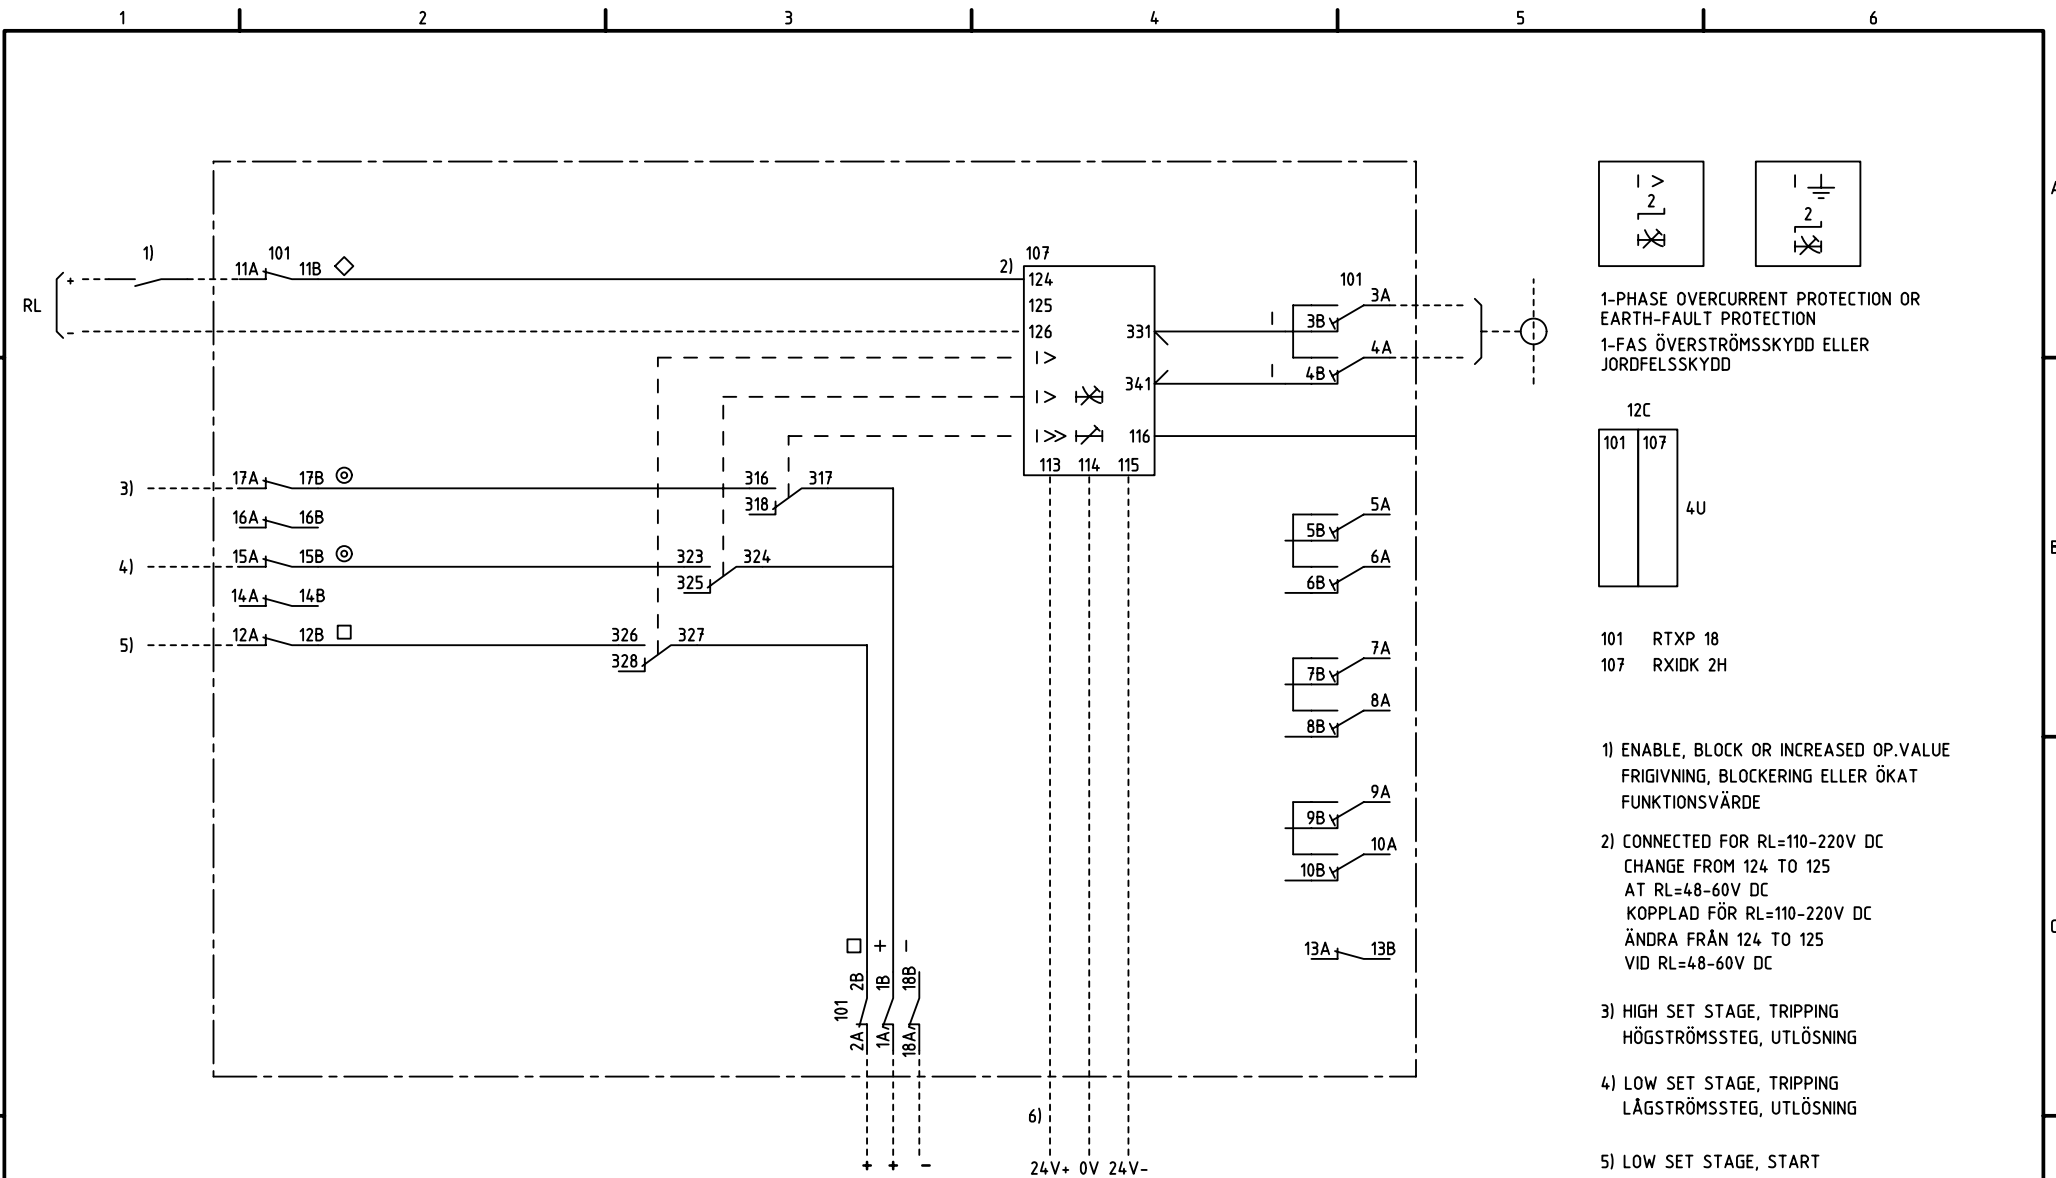

1-PHASE OVERCURRENT PROTECTION OR EARTH-FAULT PROTECTION
1-FAS ÖVERSTRÖMSSKYDD ELLER JORDFELSSKYDD



101 RXP 18
107 RXDK 2H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE
FRIGIVNING, BLOCKERING ELLER ÖKAT
FUNKTIONSVÄRDE
- 2) CONNECTED FOR RL=110-220V DC
CHANGE FROM 124 TO 125
AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 124 TO 125
VID RL=48-60V DC
- 3) HIGH SET STAGE, TRIPPING
HÖGSTRÖMSSTEG, UTLÖSNING
- 4) LOW SET STAGE, TRIPPING
LÅGSTRÖMSSTEG, UTLÖSNING
- 5) LOW SET STAGE, START
LÅGSTRÖMSSTEG, START
- 6) MUST BE ENERGIZED FROM RXTUG 21/22H
MÅSTE MATAS FRÅN RXTUG 21/22H

ELCAD ID PAT/render DATE 2004-06-230:14 - 1MRK 001002-BA Issued in ARCADE

Prepared 96-06-17 HAIDER RAZA/L OLSTAM		CIRCUIT DIAGRAM		Resp dep PAT		Rev ind 1 96.41		Lang 82	
Approved 96-07-22 P JENÄKER		RAIDK 1 OVERCURRENT PROTECTION		Sheet 1		Lang 82		Lang 82	
		RAIDK 1 ÖVERSTRÖMSSKYDD		Sheet 1		Lang 82		Lang 82	
Rev Ind Revision		Reg No 7411		Sheet 1		Lang 82		Lang 82	
Based on		Pcl 890 474		Sheet 1		Lang 82		Lang 82	

ABB ABB Network Partner AB

1MRK 001 003-BA