




We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

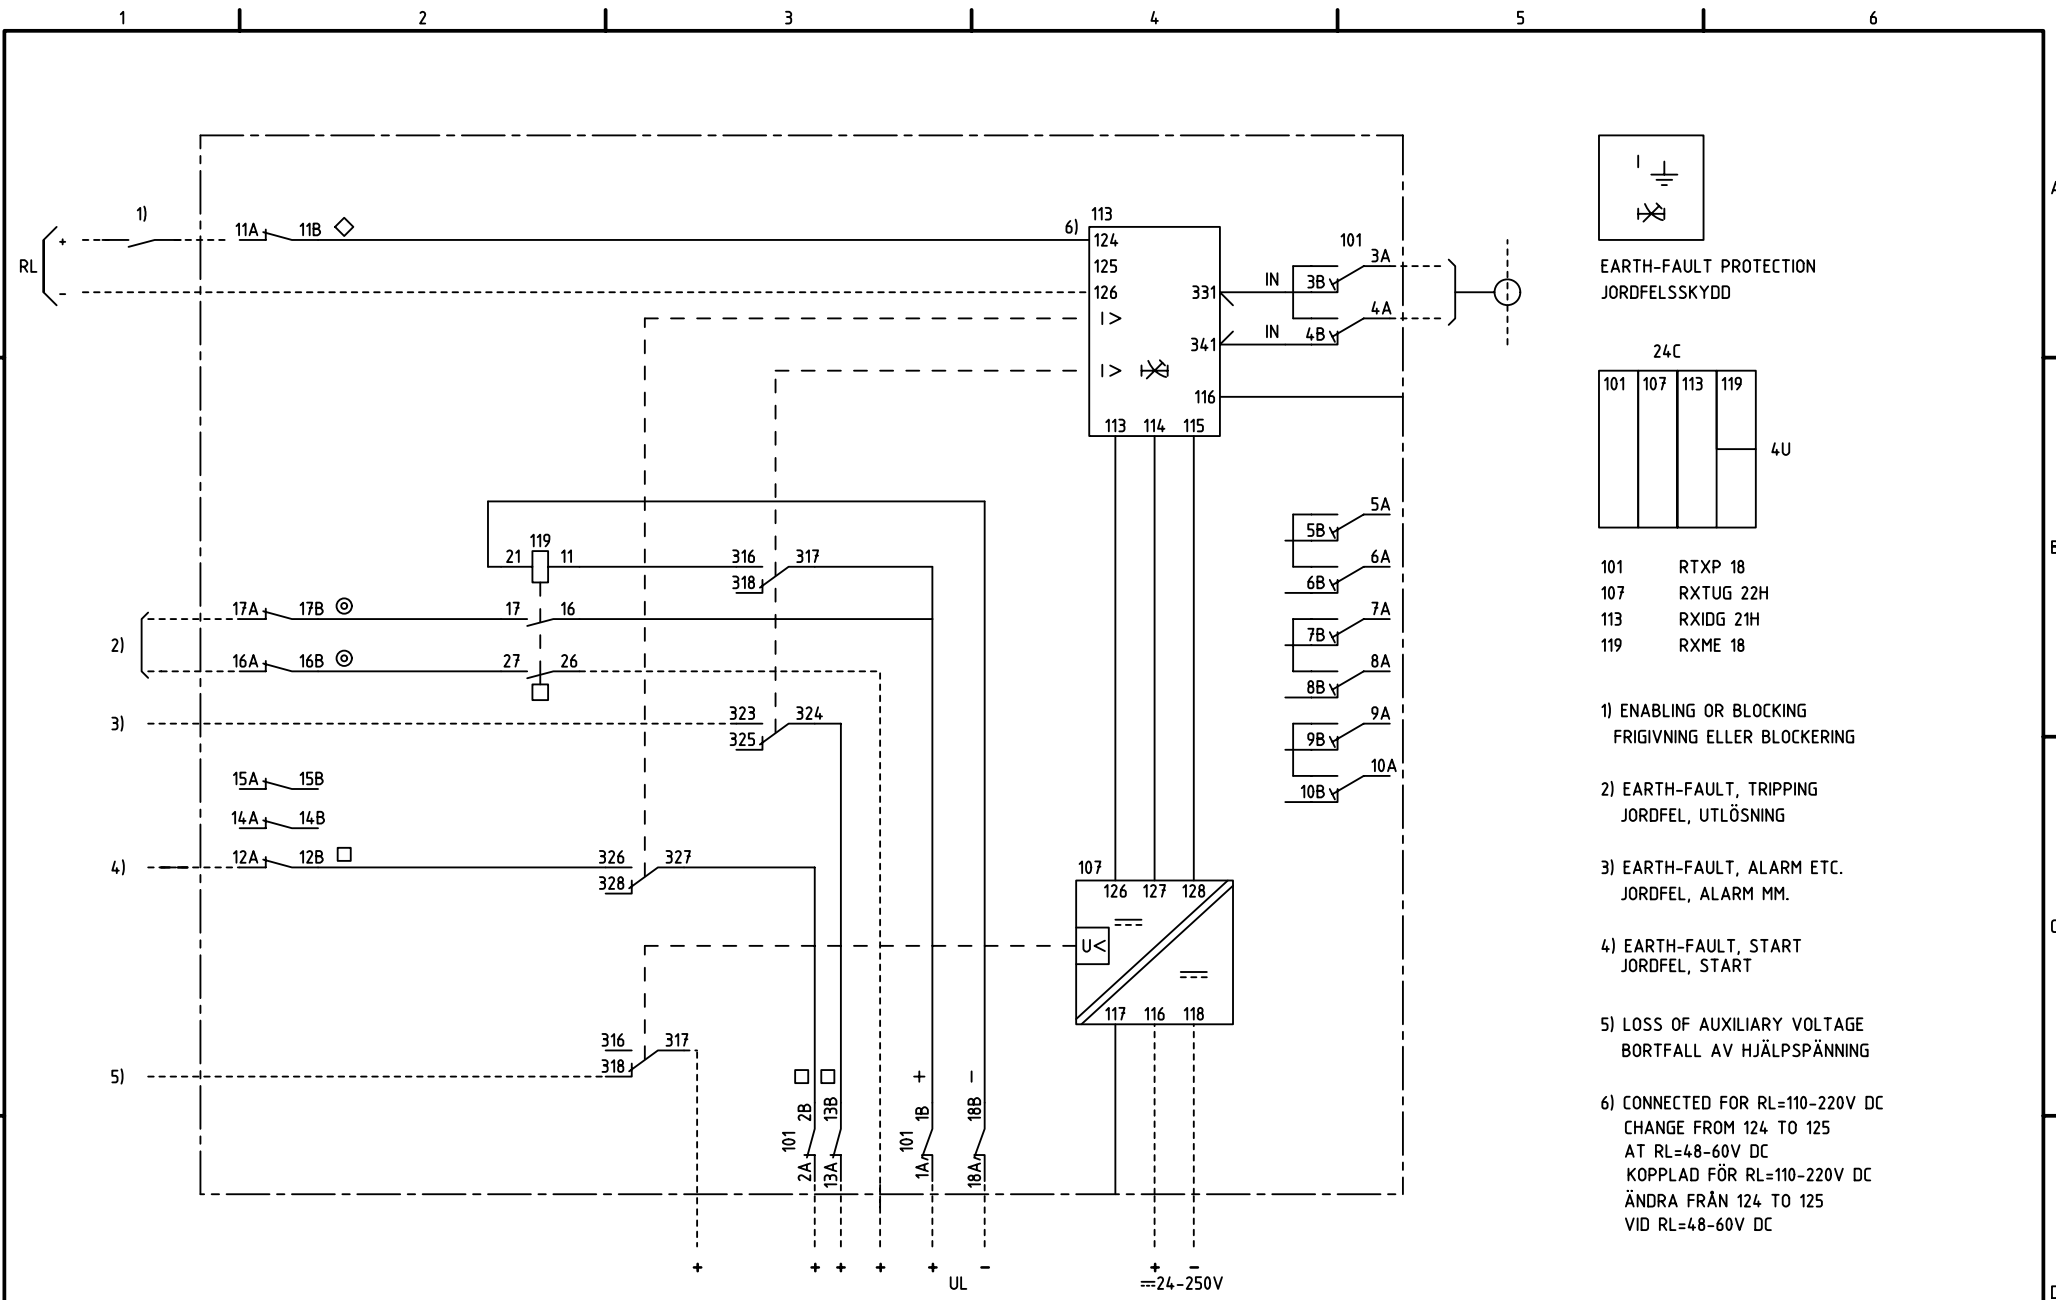

EARTH-FAULT PROTECTION  
JORDFELSSKYDD



- 101 RTXP 18
- 107 RTXUG 22H
- 113 RXIDG 21H
- 119 RXME 18

- 1) ENABLING OR BLOCKING FRIGVNING ELLER BLOCKERING
- 2) EARTH-FAULT, TRIPPING JORDFEL, UTLÖSNING
- 3) EARTH-FAULT, ALARM ETC. JORDFEL, ALARM MM.
- 4) EARTH-FAULT, START JORDFEL, START
- 5) LOSS OF AUXILIARY VOLTAGE BORTFALL AV HJÄLPSPÄNNING
- 6) CONNECTED FOR RL=110-220V DC CHANGE FROM 124 TO 125 AT RL=48-60V DC KOPPLAD FÖR RL=110-220V DC ÄNDRA FRÅN 124 TO 125 VID RL=48-60V DC

ELCAD ID TPTD/render      DATE 2004-06-223:29      1MRK 001 006-EA      Issued in ARCADE

Prepared 96-3-29 HAIDER RAZA/L OLSTAM		CIRCUIT DIAGRAM/KRETSSHEMA		Resp dep TPTD		Rev ind -		Lang 82	
Approved 96-05-13 P JENÄKER		RAIDG 1 OVERCURRENT E/F PROTECTION		RAIDG 1 ÖVERSTRÖMS- OCH JORDFELSSKYDD				Sheet 1	
Rev Ind		Revision		Reg No 7411		Lang 82		Sheet 1	
Based on		Pct 890 475		Pct 890 475		Lang 82		Cont	

**ABB** ABB Network Partner AB

**1MRK 001 007-EA**