



We reserve all rights in this document and in the information contained therein. Reproduction, use or distribution of this document without the written authority of ABB Automation Technologies AB is strictly forbidden.

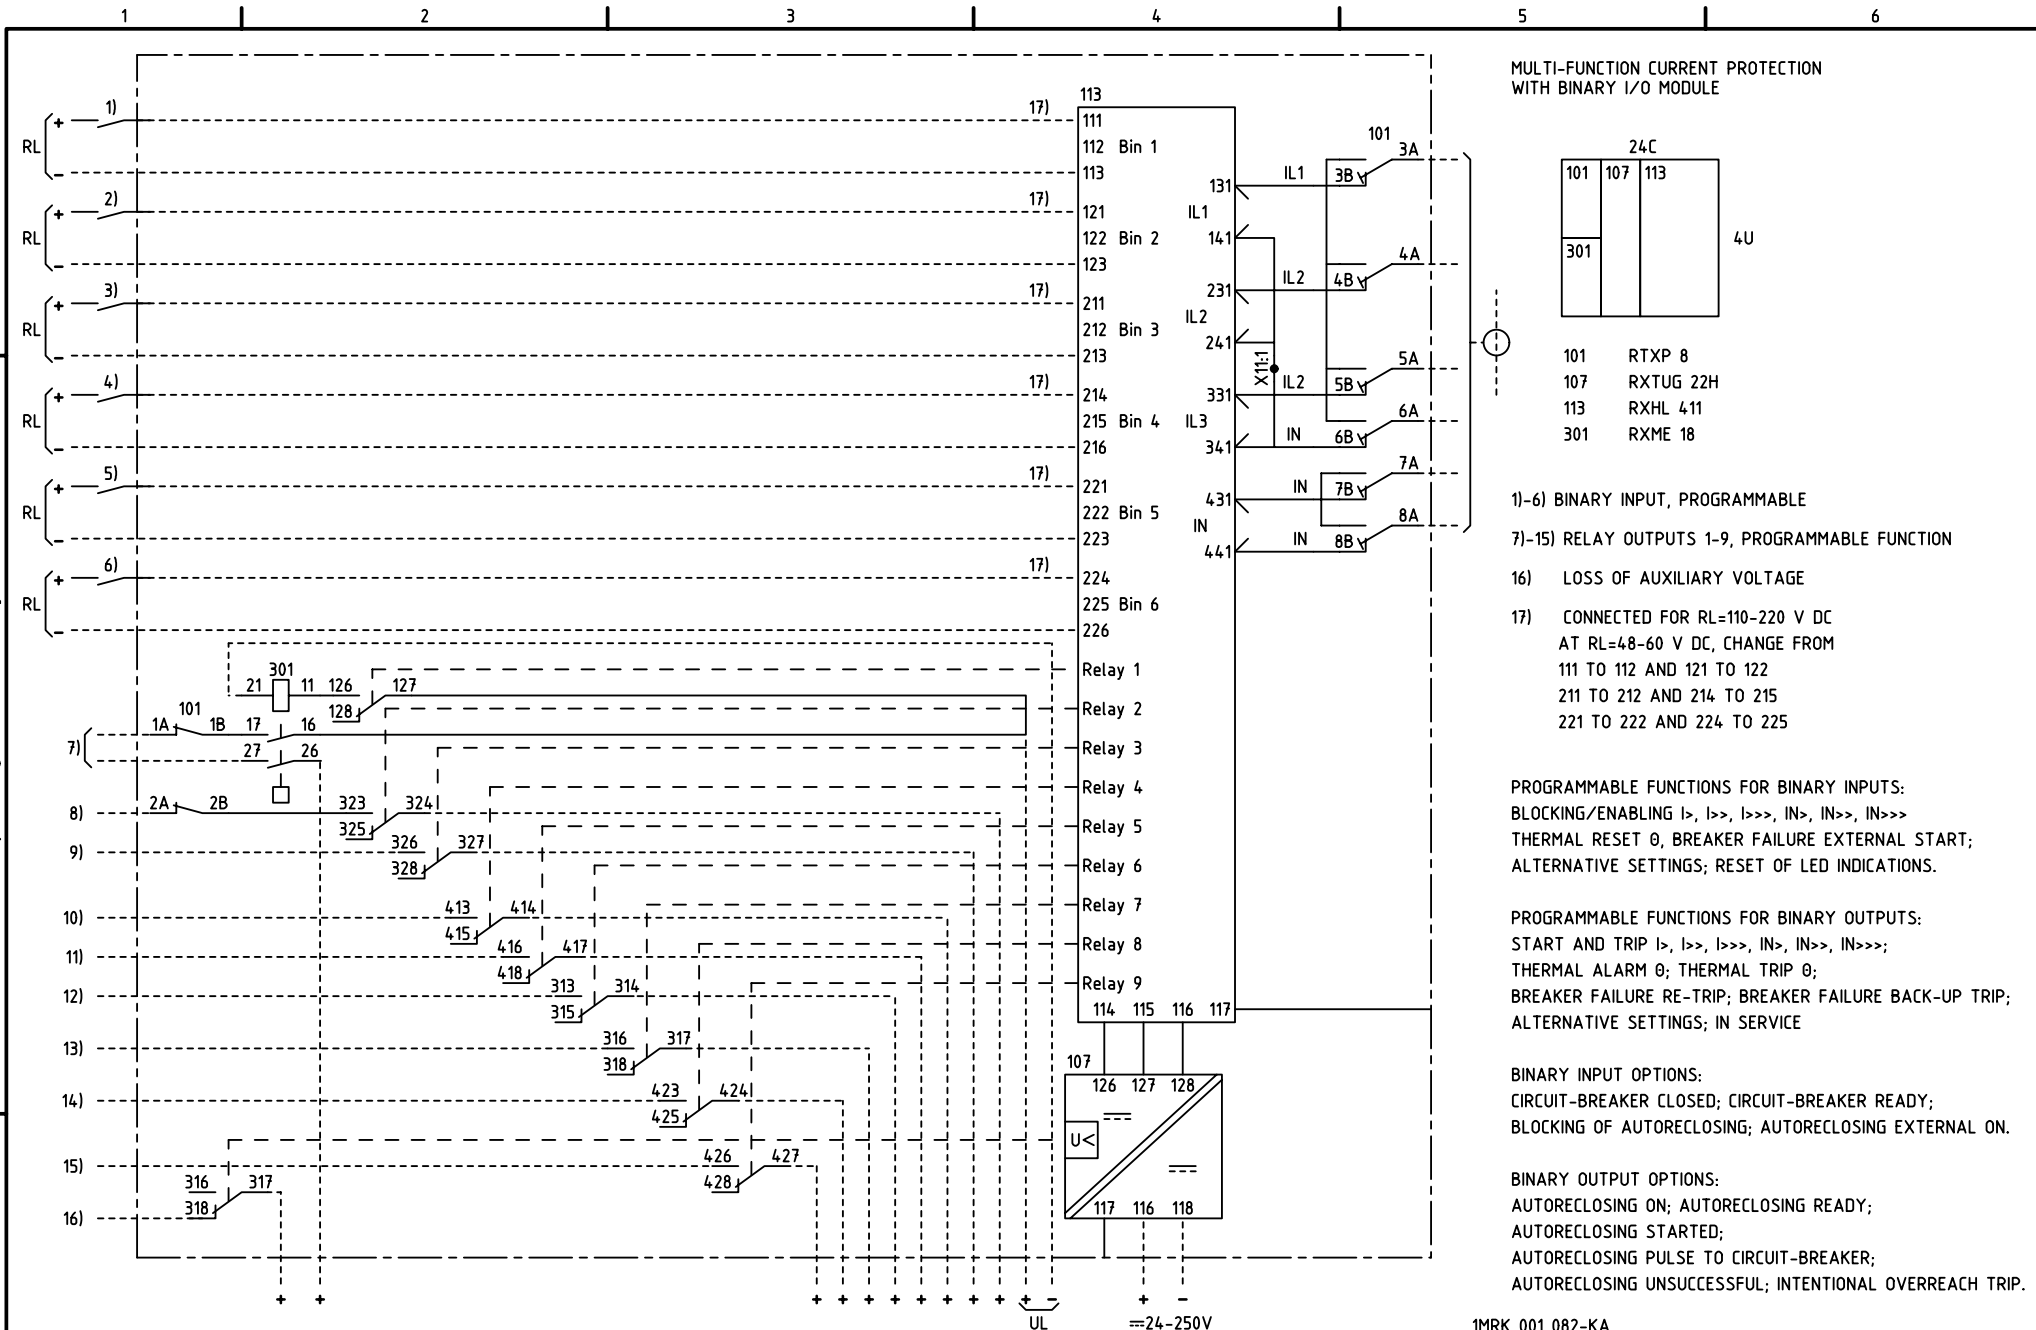

**MULTI-FUNCTION CURRENT PROTECTION WITH BINARY I/O MODULE**



- 101 RTXP 8
- 107 RXTUG 22H
- 113 RXHL 4.11
- 301 RXME 18

- 1)-6) BINARY INPUT, PROGRAMMABLE
- 7)-15) RELAY OUTPUTS 1-9, PROGRAMMABLE FUNCTION
- 16) LOSS OF AUXILIARY VOLTAGE
- 17) CONNECTED FOR RL=110-220 V DC AT RL=48-60 V DC, CHANGE FROM 111 TO 112 AND 121 TO 122, 211 TO 212 AND 214 TO 215, 221 TO 222 AND 224 TO 225

PROGRAMMABLE FUNCTIONS FOR BINARY INPUTS:  
 BLOCKING/ENABLING I>, I>>, I>>>, IN>, IN>>, IN>>>  
 THERMAL RESET 0, BREAKER FAILURE EXTERNAL START;  
 ALTERNATIVE SETTINGS; RESET OF LED INDICATIONS.

PROGRAMMABLE FUNCTIONS FOR BINARY OUTPUTS:  
 START AND TRIP I>, I>>, I>>>, IN>, IN>>, IN>>>;  
 THERMAL ALARM 0; THERMAL TRIP 0;  
 BREAKER FAILURE RE-TRIP; BREAKER FAILURE BACK-UP TRIP;  
 ALTERNATIVE SETTINGS; IN SERVICE

BINARY INPUT OPTIONS:  
 CIRCUIT-BREAKER CLOSED; CIRCUIT-BREAKER READY;  
 BLOCKING OF AUTORECLOSING; AUTORECLOSING EXTERNAL ON.

BINARY OUTPUT OPTIONS:  
 AUTORECLOSING ON; AUTORECLOSING READY;  
 AUTORECLOSING STARTED;  
 AUTORECLOSING PULSE TO CIRCUIT-BREAKER;  
 AUTORECLOSING UNSUCCESSFUL; INTENTIONAL OVERREACH TRIP.

Customer drw no	Prep. PTUA/ TPTD H Raza/JE 2000-03-24	1MRK 001 082-KA	Circuit Diagram	Cont. sh/ No of sh	
	Appr. PTUA/ Roger Karlsson 2000-03-24				Multi-f current prot.
	Resp. dept PTUA/ TPTD	Document number	Lang.	Rev.	
	Based on				<b>1MRK001083-KB</b>

**ABB** ABB Automation Technologies

Document status: Approved