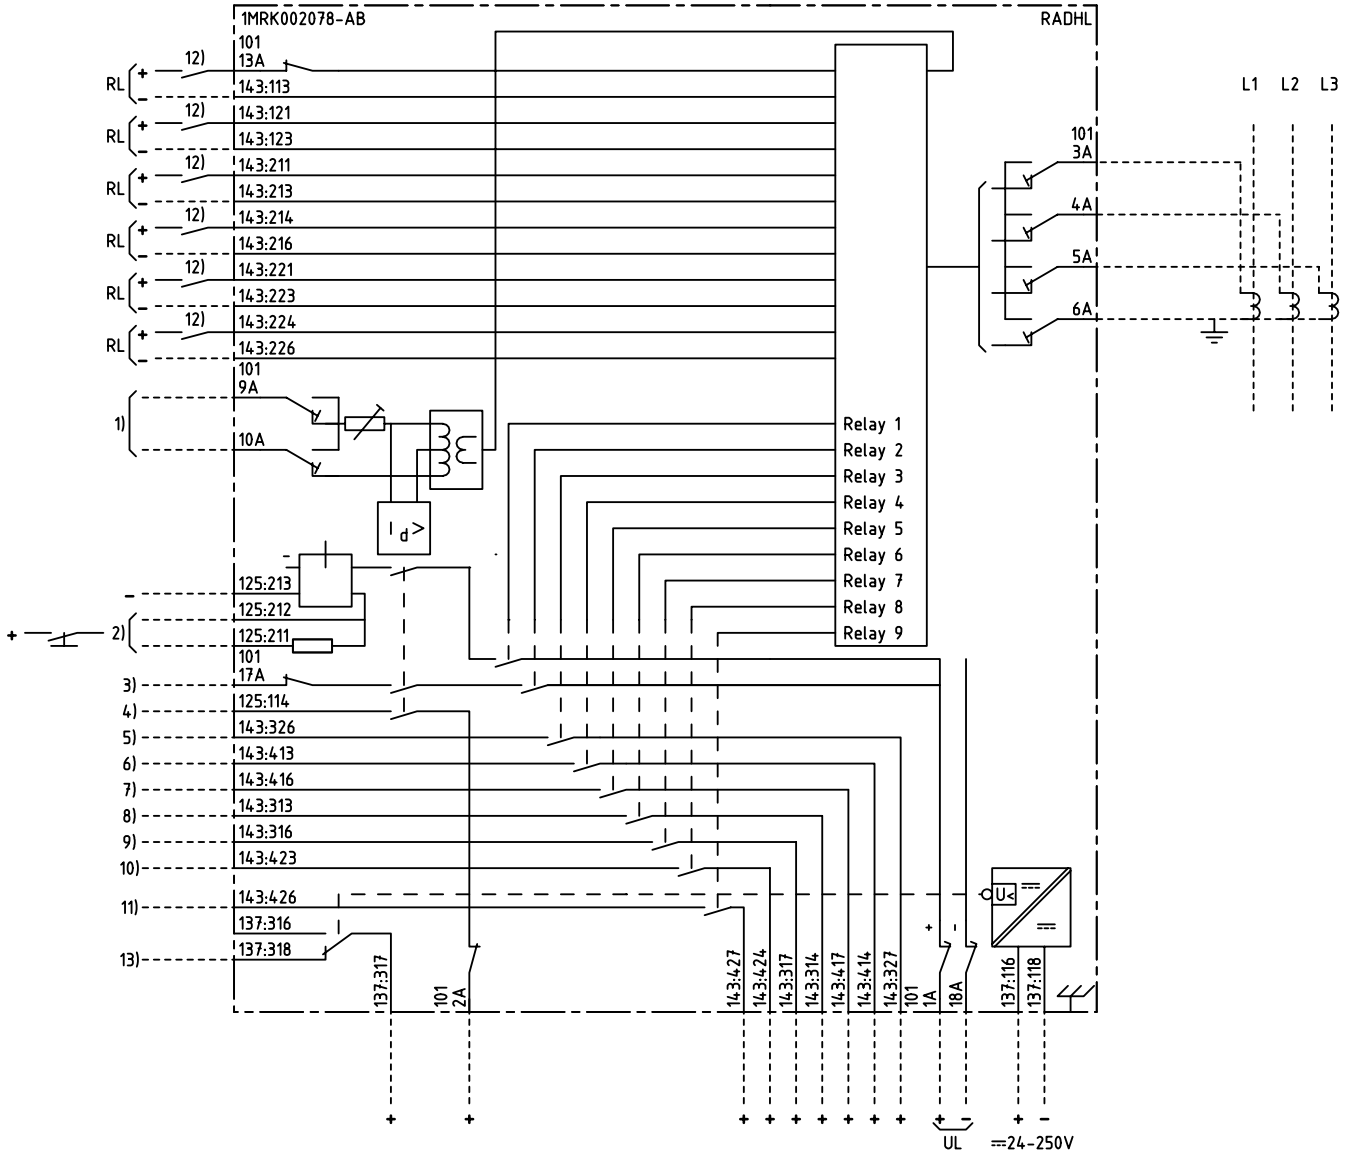

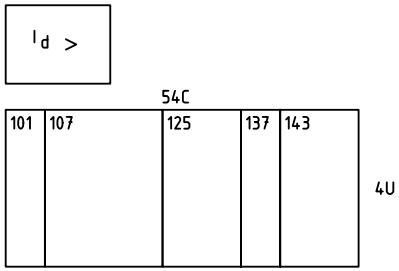

101 RTXP 18
107 TRANSFORMER UNIT
125 RXDHL 4
137 RXTUG 22H
143 RXHL 411, INCLUDED I/O OPTION

1) PILOT-WIRES

2) RESETTING
AT 110-250V DC CONNECT TO 211
AT 24-55V DC CONNECT TO 212

3) TRIPPING ETC.

4) ALARM ETC.

3)-11) RELAY OUTPUTS
PROGRAMMABLE FUNCTION RELAY 1-9

12) BINARY INPUT, PROGRAMMABLE

13) LOSS OF AUXILIARY VOLTAGE

We reserve all rigths in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © ABB Automation Technologies AB

Customer drw no	Prep. PTUA/ TPTD Eriksson Jill 2003-02-27	Connection Diagram		Cont. sh/ No of sh
	Appr. PTUA/ SA/DP Jonsson Patrik 2003-04-15	Differential protection		
	Resp. dept PTUA/ TPTD			
Based on	ABB Automation Technologies	Documentnumber 1MRK002078-ABA	Lang. en	Rev. -	Sheet 1

Documentstatus: Approved