




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written permission of ABB Network Partner AB is strictly forbidden.

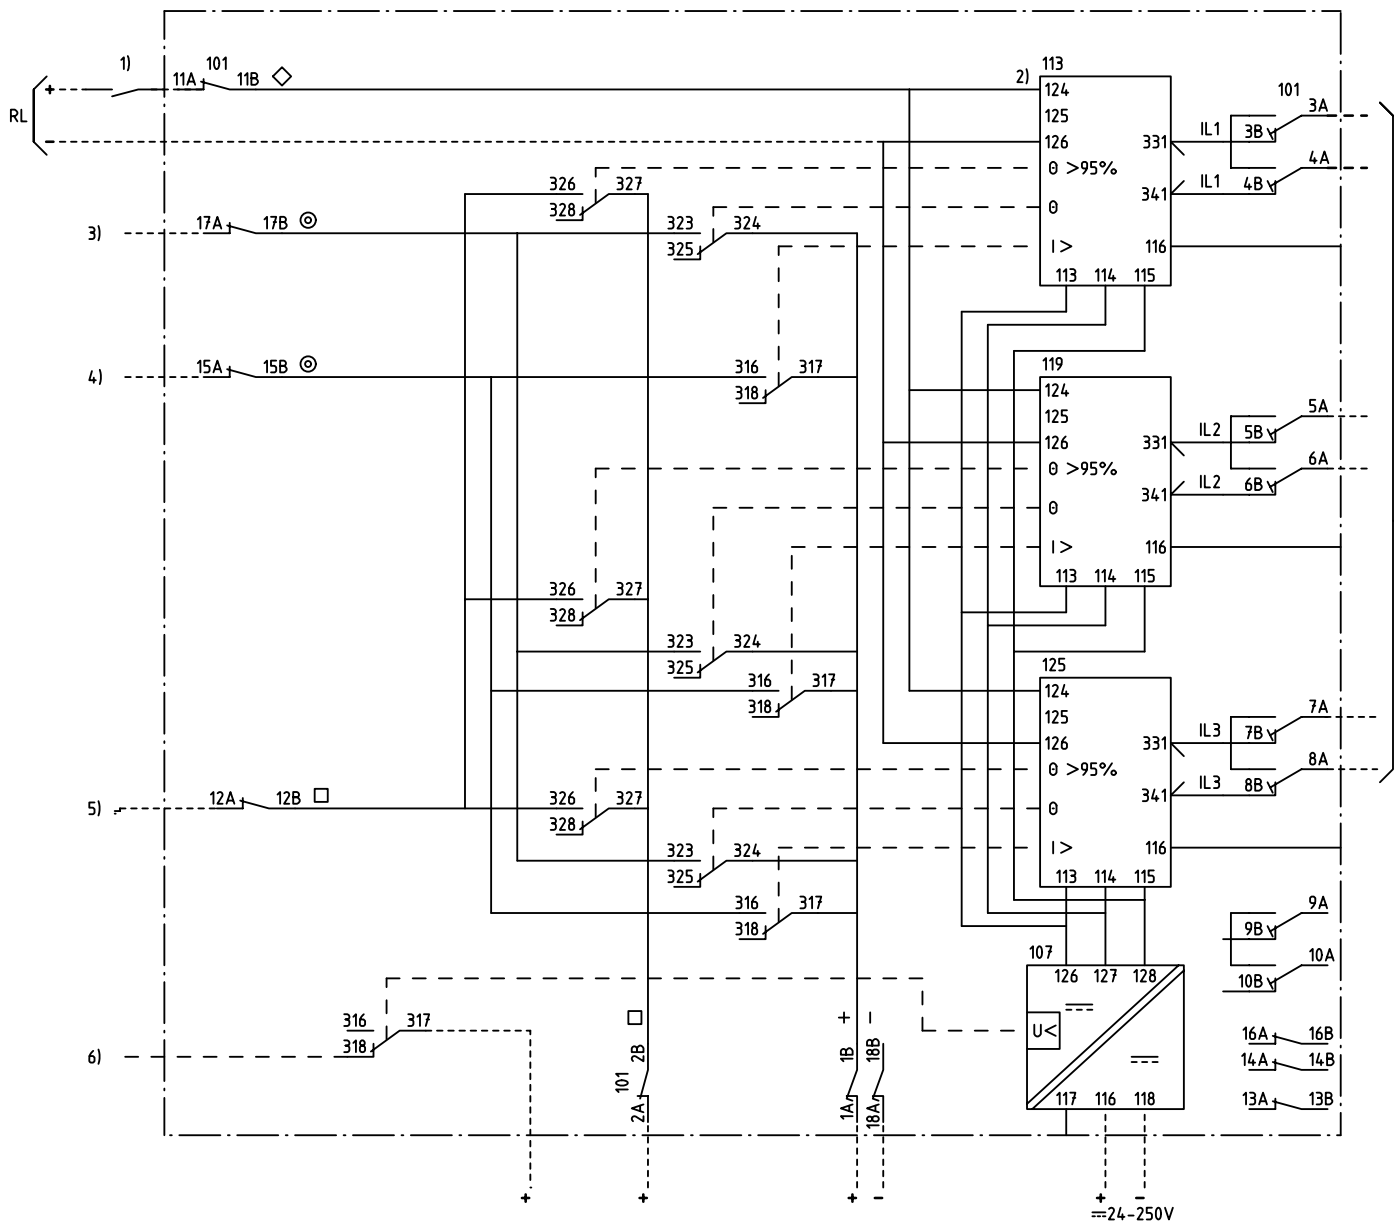

3-PH THERMAL OVERCURRENT PROTECTION  
3-FAS TERMISKT ÖVERSTRÖMSSKYDD



101 RTXP 18  
107 RXTUG 22H  
113,119,125 RXVK 2H

- 1) RESETTING OF INDICATION OR THERMAL CONTENT AND INDICATION  
ÅTERSTÄLLNING AV INDIKERING ELLER AV TERMISKT INNEHÅLL OCH INDIKERING
- 2) CONNECTED FOR RL= 110-220V DC  
CHANGE FROM 124 TO 125 AT RL=48-60V DC  
KOPPLAD FÖR RL=110-220V DC  
ÄNDRA FRÅN 124 TILL 125 VID RL=48-60V DC
- 3) TRIPPING THERMAL OVERLOAD  
UTLÖSNING ÖVERLAST
- 4) TRIPPING OVERCURRENT  
UTLÖSNING ÖVERSTRÖM
- 5) ALARM THERMAL OVERLOAD  
ALARM ÖVERLAST
- 6) LOSS OF AUXILIARY VOLTAGE  
BORTFALL AV HJÄLPSPÄNNING

ELCAD ID TPTD/render

DATE 2004-06-221:22

1MRK 001 017-PA

Issued in ARCADE

Prepared 96-01-16 H RAZA		CIRCUIT DIAGRAM/KRETSSHEMA		Resp dep TPTD		Rev ind 1 96.18		Lang 82	
Approved 96-02-16 Peter Jenøker		RAVK 3 THERMAL OVERCURRENT PROTECTION		Sheet 1		Lang 82		Lang 82	
Rev Ind Revision		Reg No 7411		Sheet 1		Lang 82		Lang 82	
Based on		Pcl 890 482		Sheet 1		Lang 82		Lang 82	

**ABB** ABB Network Partner AB

**1MRK 001 018-PA**

Sheet 1  
Cont