


We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

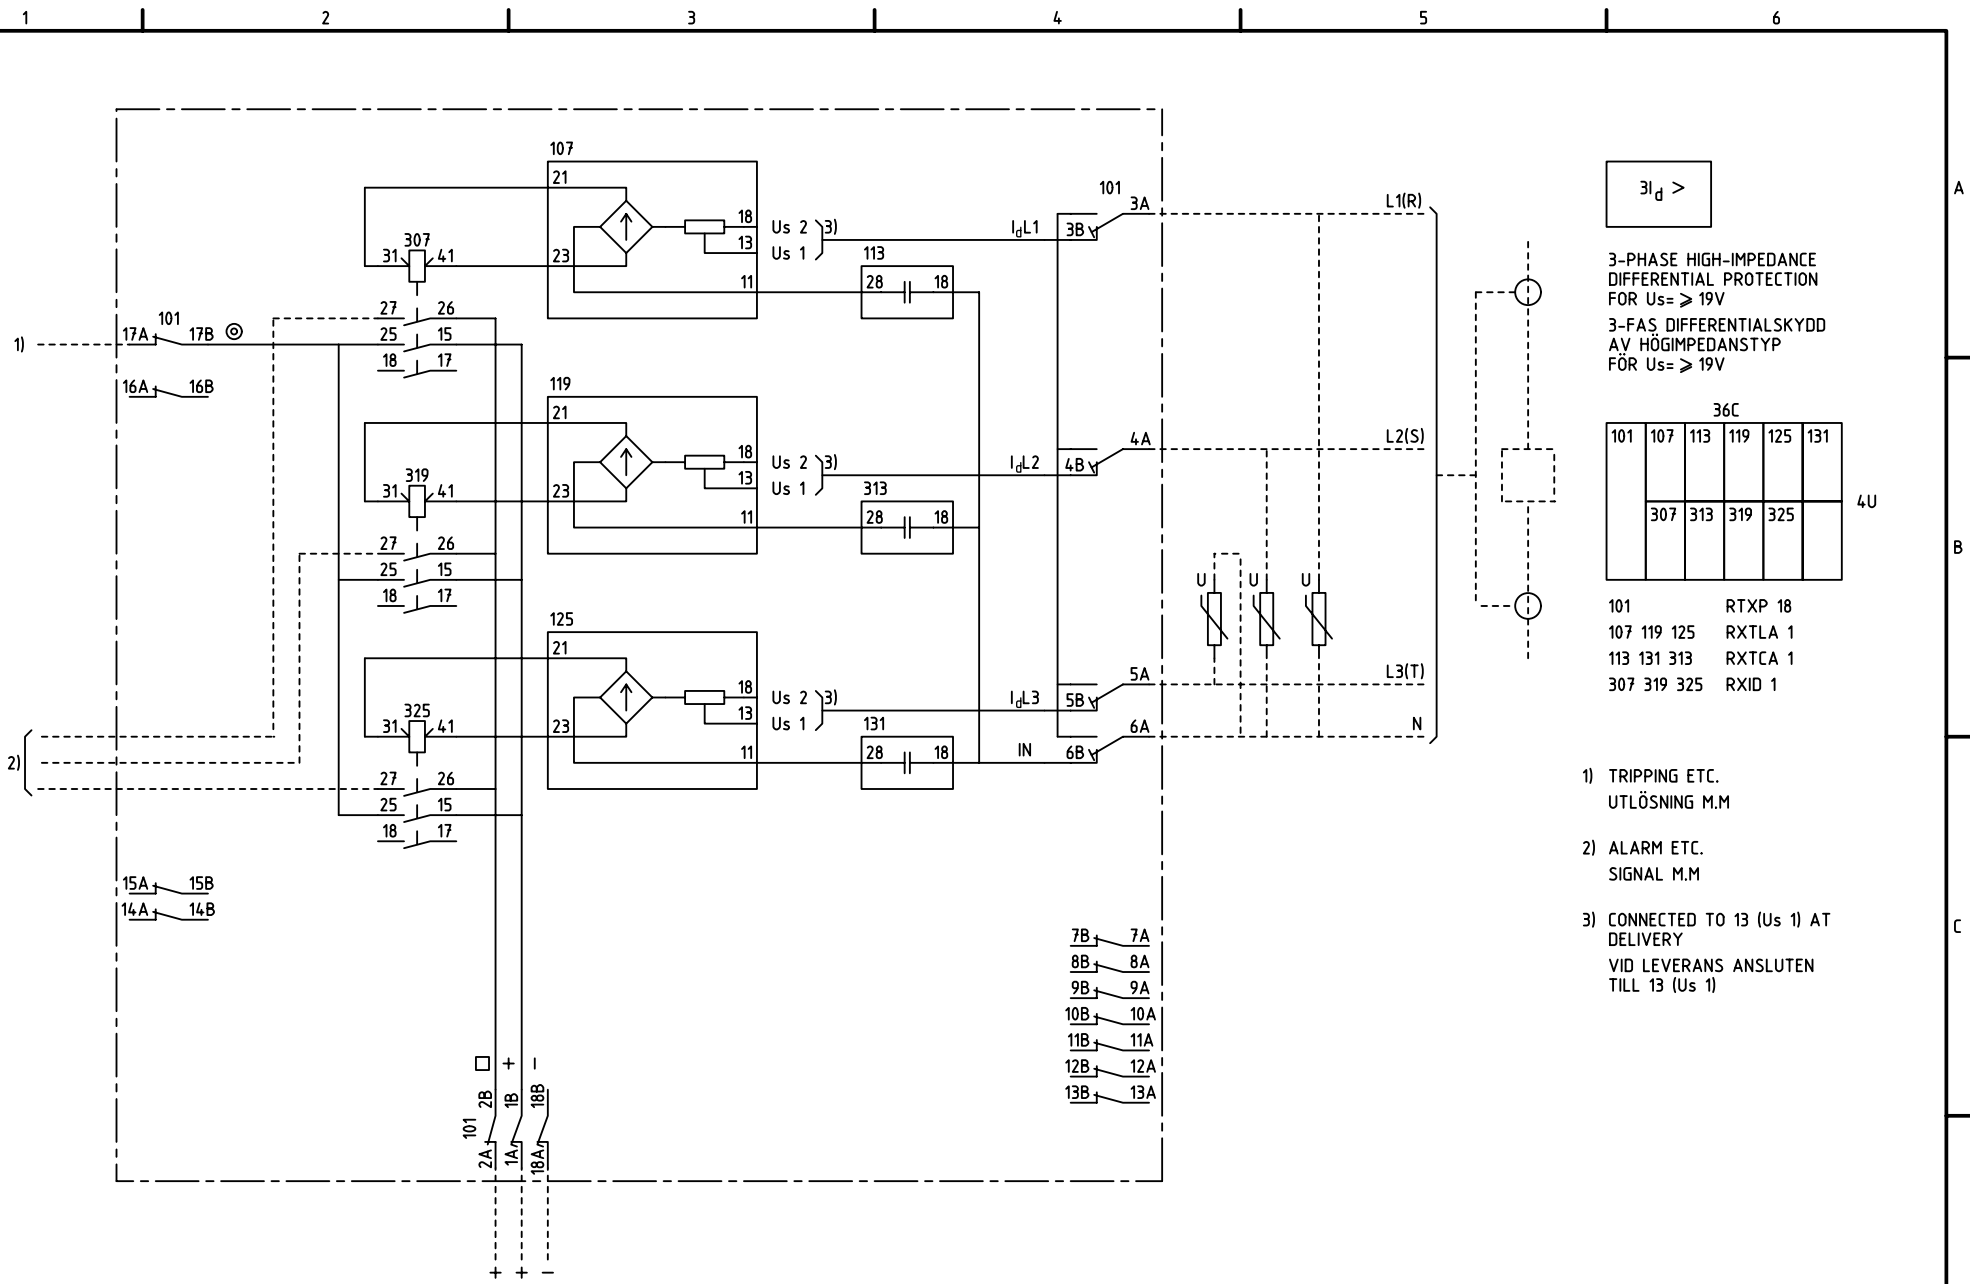

$3I_d >$

3-PHASE HIGH-IMPEDANCE DIFFERENTIAL PROTECTION FOR  $U_s \geq 19V$

3-FAS DIFFERENTIALSKYDD AV HÖGIMPEDANSTYP FÖR  $U_s \geq 19V$

36C					
101	107	113	119	125	131
	307	313	319	325	

101 RTXP 18  
 107 119 125 RXTLA 1  
 113 131 313 RXTCA 1  
 307 319 325 RXID 1

- 1) TRIPPING ETC.  
UTLÖSNING M.M
- 2) ALARM ETC.  
SIGNAL M.M
- 3) CONNECTED TO 13 (Us 1) AT DELIVERY  
VID LEVERANS ANSLUTEN TILL 13 (Us 1)

ELCAD ID PAT/render		DATE 2004-06-2219:23		RK 646 009-AA		Issued in ARCADE	
		Prepared 76 27	R ÖSTLUND		CIRCUIT DIAGRAM/KRETSSCHEMA		
		Approved 76 27	P JENÄKER		RADHA DIFFERENTIAL PROTECTION		
					DIFFERENTIALSKYDD		
Rev Ind	Revision	Reg No 7417			Resp dep PAT	Rev ind 4 96.45	Lang 82
Based on		Pcl 890.646			<b>ABB Network Partner AB</b>		Sheet 1
						<b>7417 015-AA</b>	Cont