



We reserve all rights in this document and in the information contained therein. Reproduction, use or distribution of this document without the written permission of ABB Automation Technologies AB is strictly forbidden. © ABB Automation Technologies AB

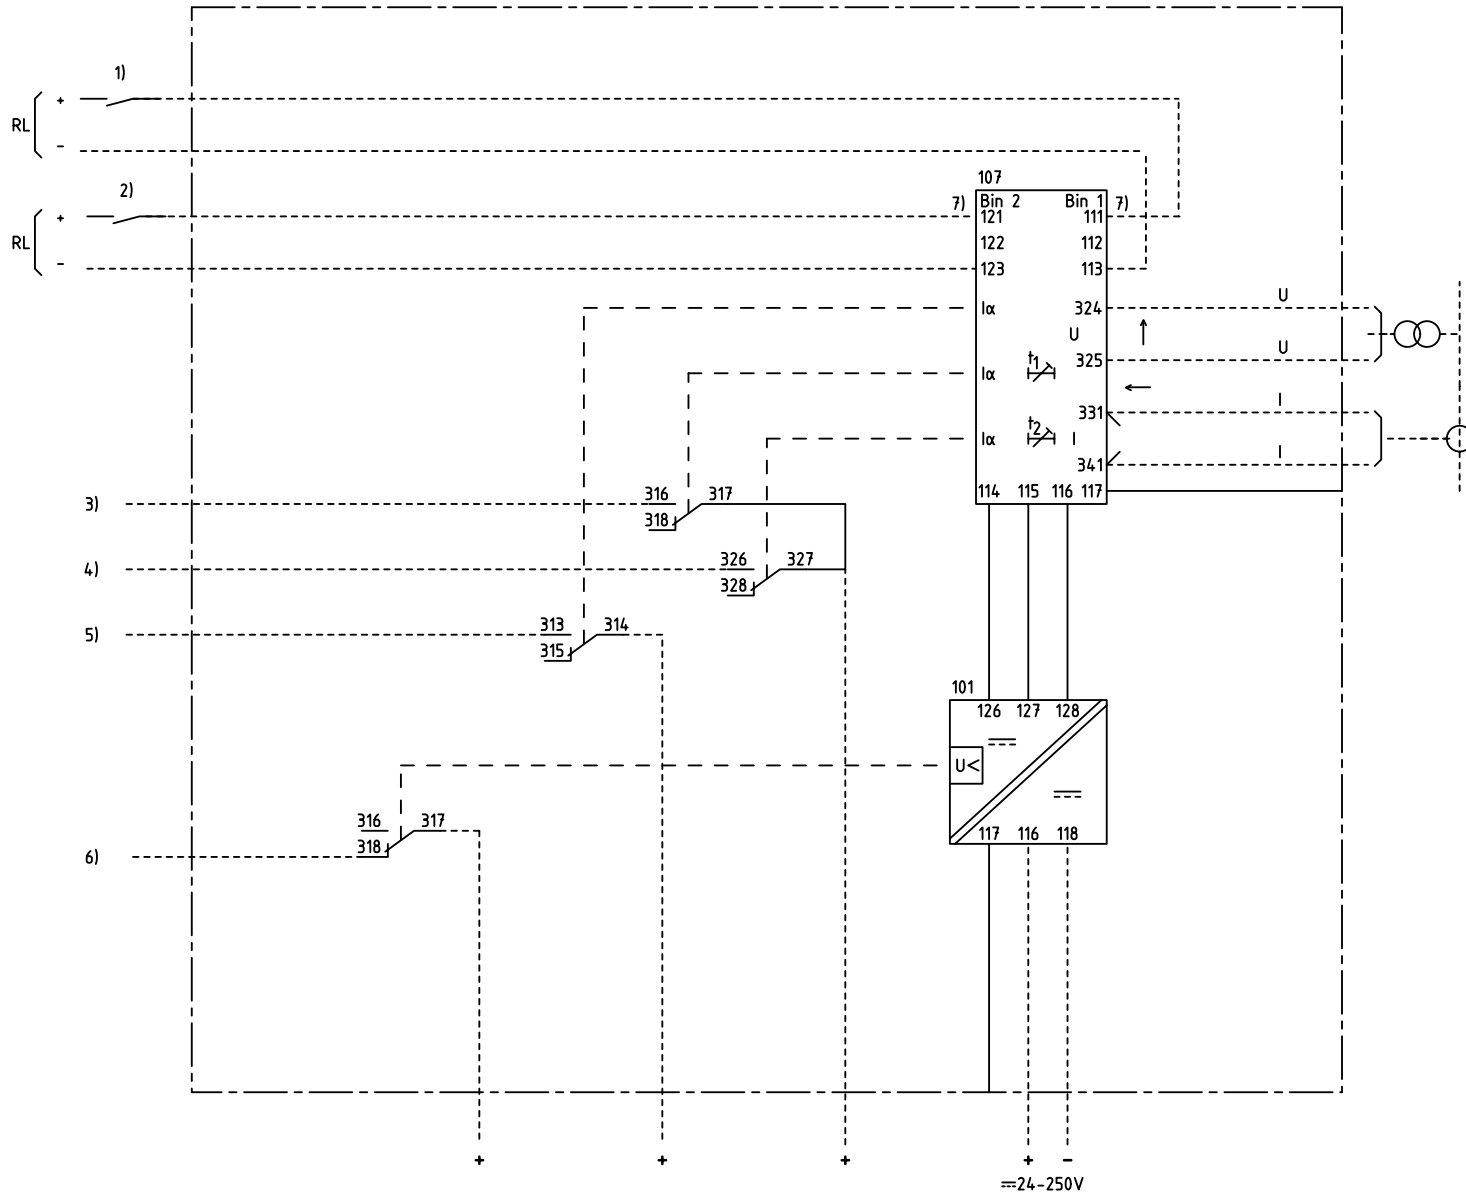

REVERSE POWER PROTECTION, DELAYED
BAKEFFEKTSKYDD, FÖRDRÖJT



101 RXTUG 22H
107 RXPPK 2H

- 1) BLOCKING/ENABLING OF TRIP t1
BLOCKERING/FRIGIVNING AV UTLÖSNING t1
- 2) RESETTING OF INDICATION
ÅTERSTÄLLNING AV INDIKERING
- 3) REVERSE POWER, TRIP t1
BAKEFFEKT, UTLÖSNING t1
- 4) REVERSE POWER, TRIP t2
BAKEFFEKT, UTLÖSNING t2
- 5) REVERSE POWER, START
BAKEFFEKT, START
- 6) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING
- 7) CONNECTED FOR RL=110-220V DC
CHANGE FROM 111 TO 112 AND
121 TO 122 AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 111 TILL 112 OCH
121 TILL 122 VID RL=48-60V DC

Customer drw no	Prep. PTUA/ TPTD 1MRK001058-CA	2000-05-29	Circuit Diagram	Issued in	APR 2000
	Appr. PTUA/ Roger Karlsson	2000-05-29			
	Resp. dept PTUA/ TPTD		Document number	Lang.	Rev.
Based on	ABB ABB Automation Technologies		1MRK001058-CA	82	A
					Sheet
					1

Document status: Approved