


We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

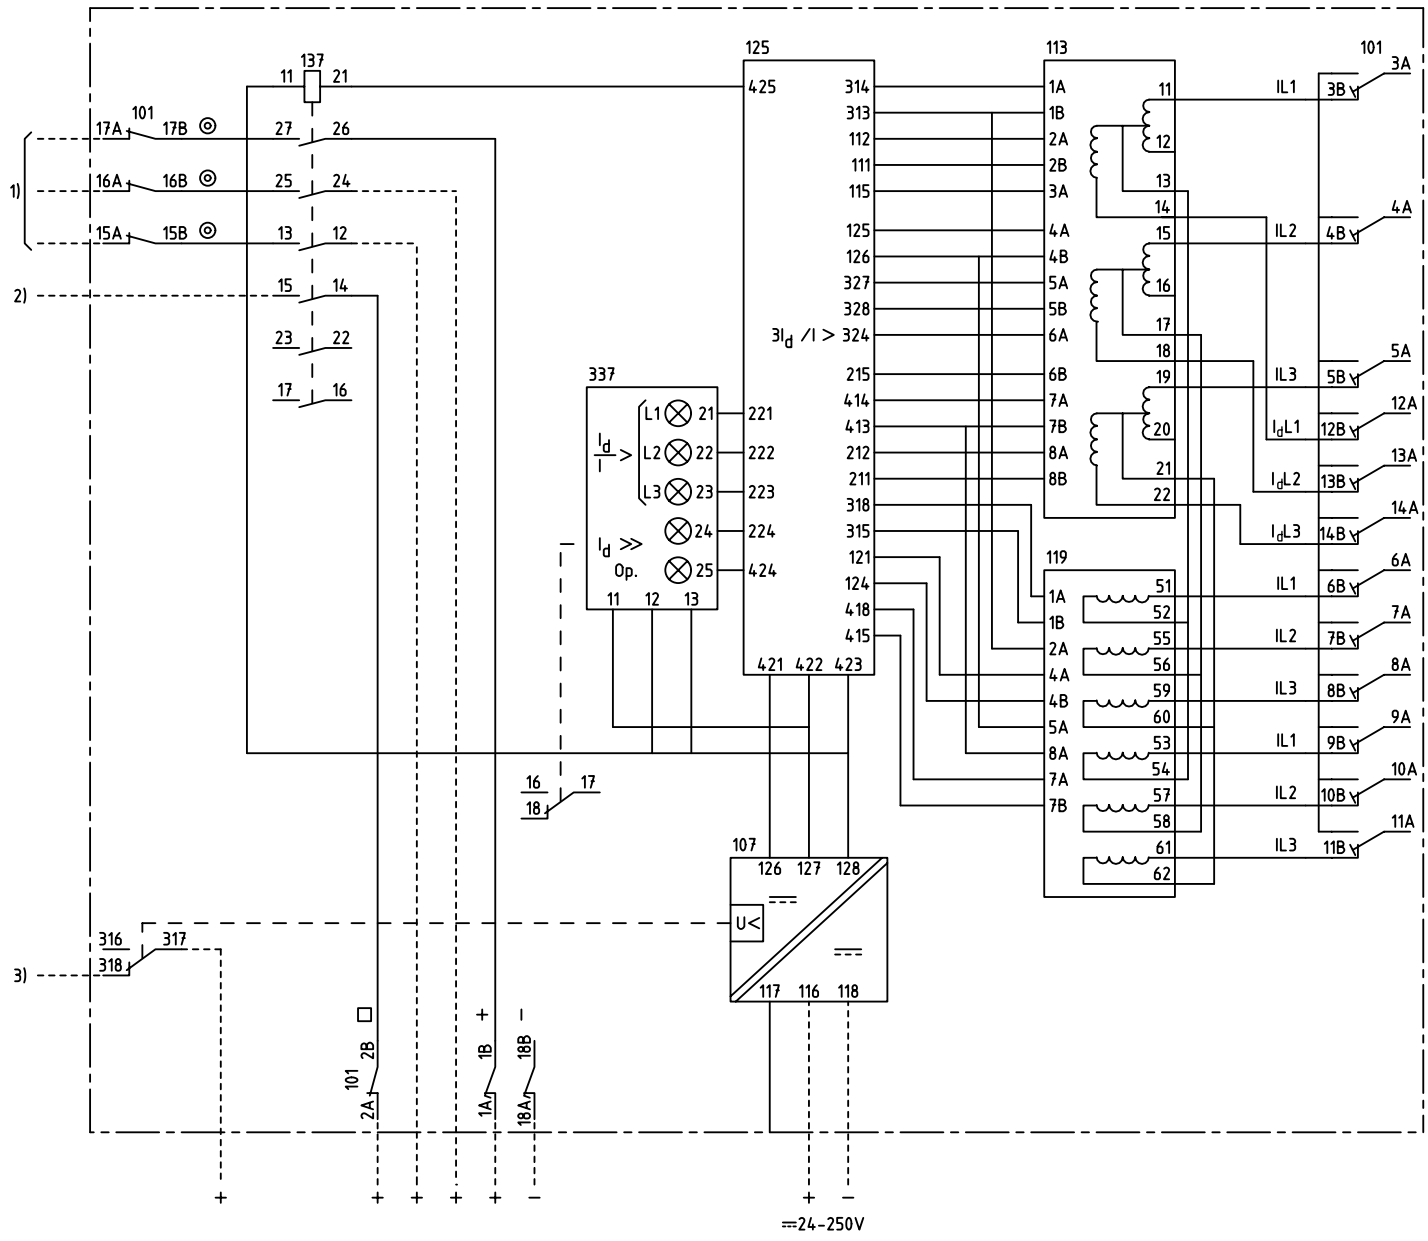

$3 I_d / I >$

TRANSFORMER DIFFERENTIAL PROTECTION WITH THREE INPUT CIRCUIT RESTRAINTS AND PHASE INDICATOR
 TRANSFORMATORDIFFERENTIALSKYDD MED TRE STABILISERANDE INGÅNGAR OCH FASINDIKERING

42C					
101	107	113	119	125	137
					337
					4U

- 101 RTXP 18
- 107 RXTUG 22H
- 113 RTQTB 060
- 119 RTQTB 061
- 125 RXDSB 4
- 137 RXMS 1
- 337 RXSGA 1

- 1) TRIP ETC.
UTLÖSNING M.M
- 2) ALARM ETC.
SIGNAL M.M
- 3) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING

ELCAD ID PS/render		DATE 2004-06-230:38		RK 625 005-CA		Issued in ARCADE	
		Prepared 85.34	C-H EINVALL		CIRCUIT DIAGRAM/KRETSSCHEMA		
		Approved 85.34	P JENÄKER		RADS B DIFFERENTIAL PROTECTION		
					DIFFERENTIALSKYDD		
Rev Ind	Revision	Reg No 7454			Resp dep PS	Rev Ind 3 98-02-06	Lang 82
Based on		Pcl 890.625			ABB ABB Network Partner AB		Sheet 1
						7454 356-CC	
						Cont	