




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written permission of ABB Network Partner AB is strictly forbidden.

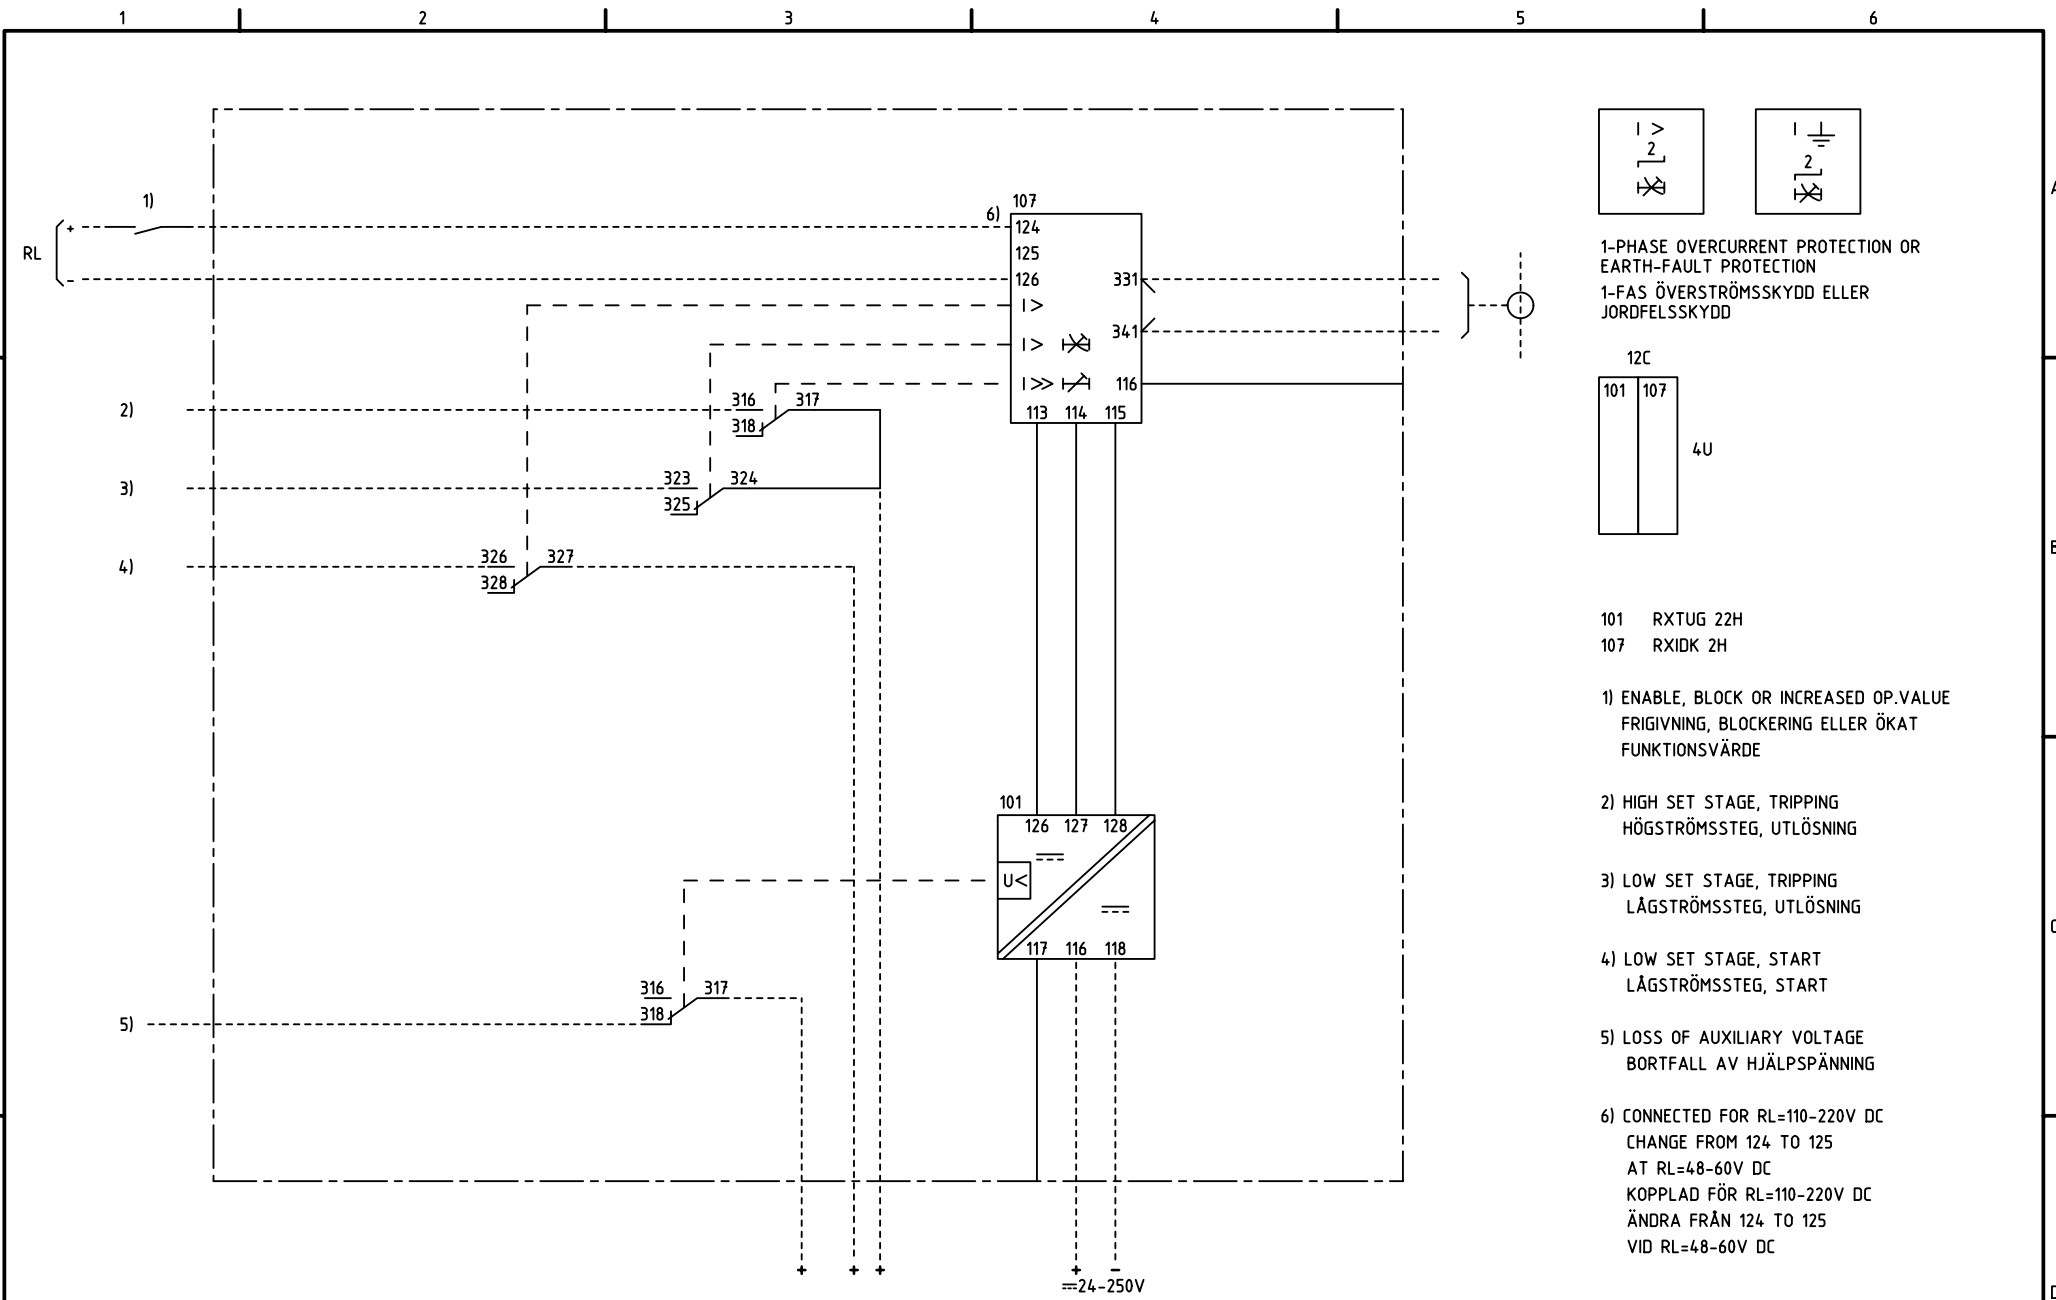

1-PHASE OVERCURRENT PROTECTION OR EARTH-FAULT PROTECTION
1-FAS ÖVERSTRÖMSSKYDD ELLER JORDFELSSKYDD



101 RXTUG 22H
107 RXIDK 2H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE FRIGIVNING, BLOCKERING ELLER ÖKAT FUNKTIONSVÄRDE
- 2) HIGH SET STAGE, TRIPPING HÖGSTRÖMSSTEG, UTLÖSNING
- 3) LOW SET STAGE, TRIPPING LÄGSTRÖMSSTEG, UTLÖSNING
- 4) LOW SET STAGE, START LÄGSTRÖMSSTEG, START
- 5) LOSS OF AUXILIARY VOLTAGE BORTFALL AV HJÄLPSPÄNNING
- 6) CONNECTED FOR RL=110-220V DC CHANGE FROM 124 TO 125 AT RL=48-60V DC KOPPLAD FÖR RL=110-220V DC ÄNDRA FRÅN 124 TO 125 VID RL=48-60V DC

ELCAD ID PAT/render DATE 2004-06-23:22 - 1MRK 001002-CA Issued in ARCADE

Prepared 96-09-09 HAIDER RAZA/L BERGMAN		CIRCUIT DIAGRAM/KRETSSHEMA	
Approved 96-09-23 P JENÄKER		RAIDK 1 OVERCURRENT PROTECTION	
		RAIDK 1 ÖVERSTRÖMSSKYDD	
Rev Ind	Revision	Reg No 7411	Lang 82
Based on	Pct 890 474	1MRK 001 003-CA	
		Sheet 1	Cont

ABB ABB Network Partner AB