



We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written consent of ABB Automation Technologies AB is strictly forbidden.

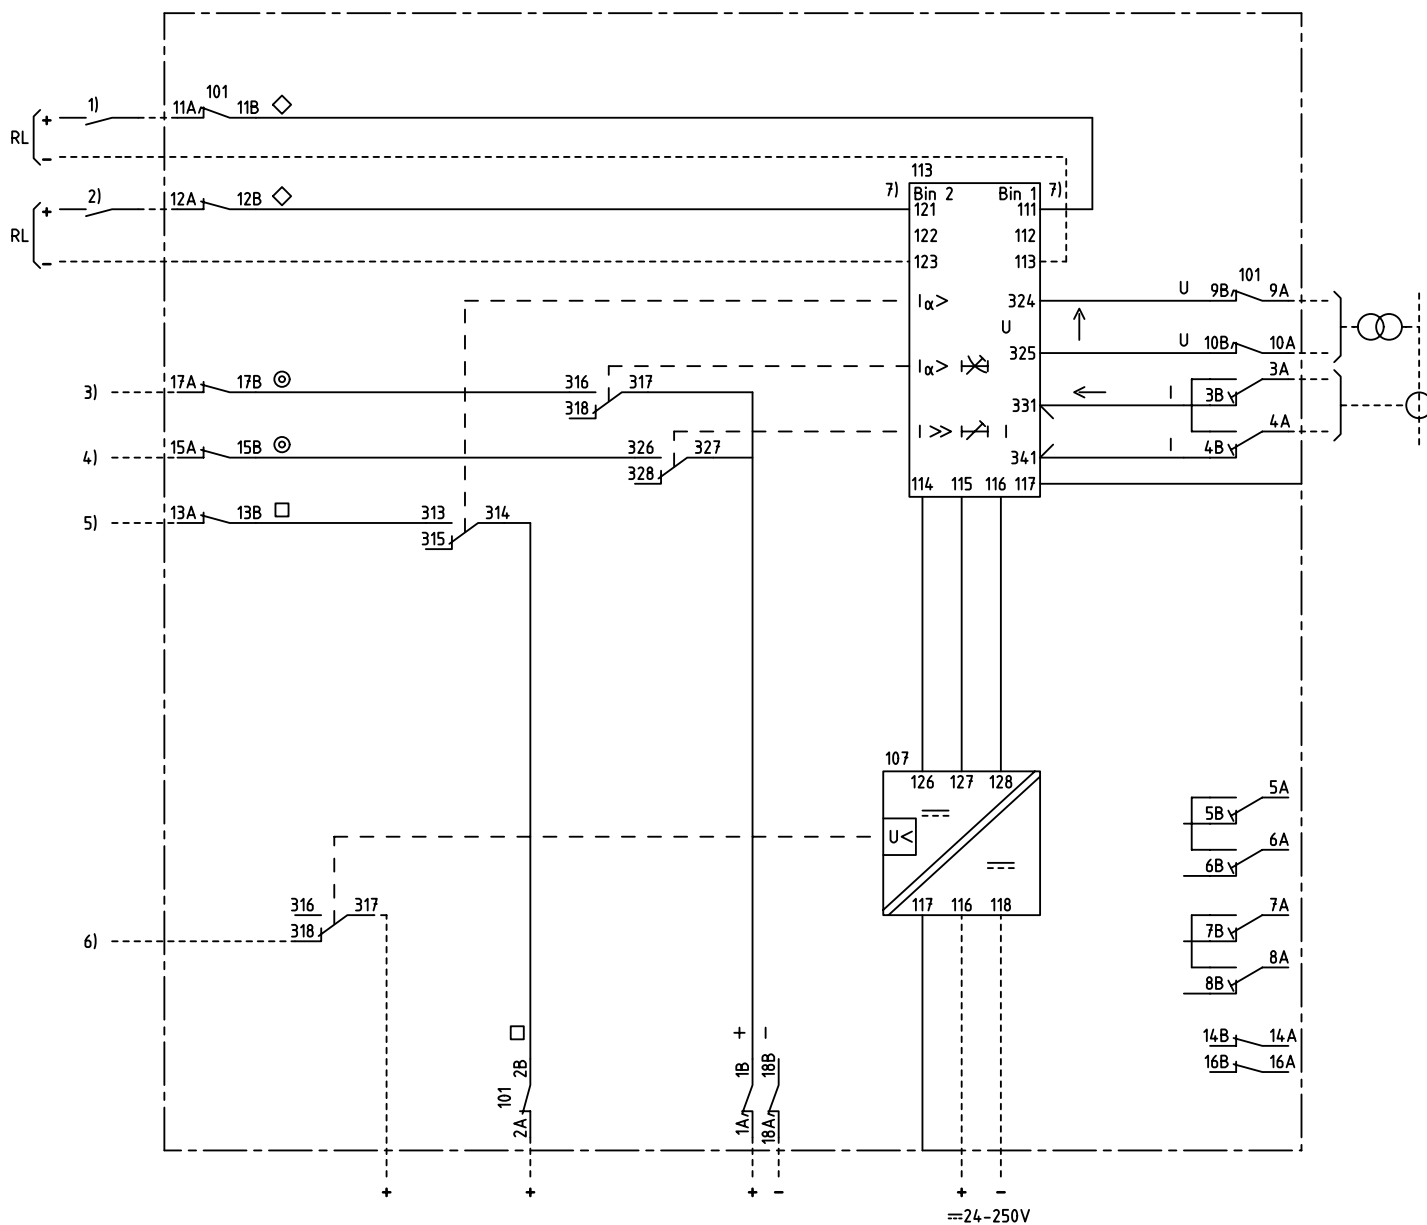

DIRECTIONAL EARTH FAULT PROTECTION, DELAYED
RIKTAT JORDFELSSKYDD, FÖRDRÖJT



101 RTXP 18
107 RXTUG 22H
113 RXPDK 23H

- 1) BLOCKING/ENABLING ONLY OF $I_{\alpha>}$ AND $I_{\alpha<}$
BLOCKERING/FRIGIVNING ENDAST AV $I_{\alpha>}$ OCH $I_{\alpha<}$
- 2) RESETTING OF INDICATION
ÅTERSTÄLLNING AV INDIKERING
- 3) DIRECTIONAL EARTH FAULT, TRIPPING
RIKTAT JORDFEL, UTLÖSNING
- 4) EARTH FAULT, TRIPPING
JORDFEL, UTLÖSNING
- 5) DIRECTIONAL EARTH FAULT, START
RIKTAT JORDFEL, START
- 6) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING
- 7) CONNECTED FOR RL=110-220V DC
CHANGE FROM 111 TO 112 AND
121 TO 122 AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 111 TILL 112 OCH
121 TILL 122 VID RL=48-60V DC

Customer drw no	Prep. PTUA/ TPTD 1MRK001091-DA 1998-10-29	Circuit Diagram	Conf. sh/ No of sh
	Appr. PTUA/ Roger Karlsson 1999-02-02		
Based on	Resp. dept PTUA/ TPTD	Document number	Sheet
		ABB ABB Automation Technologies	1MRK001092-DA
		Lang. 82	Rev. -
			1

Document status: Approved