




We reserve all rights in this document and in the information contained therein. Reproduction, use or distribution of this document without the written authority of ABB Network Partner AB is strictly forbidden.

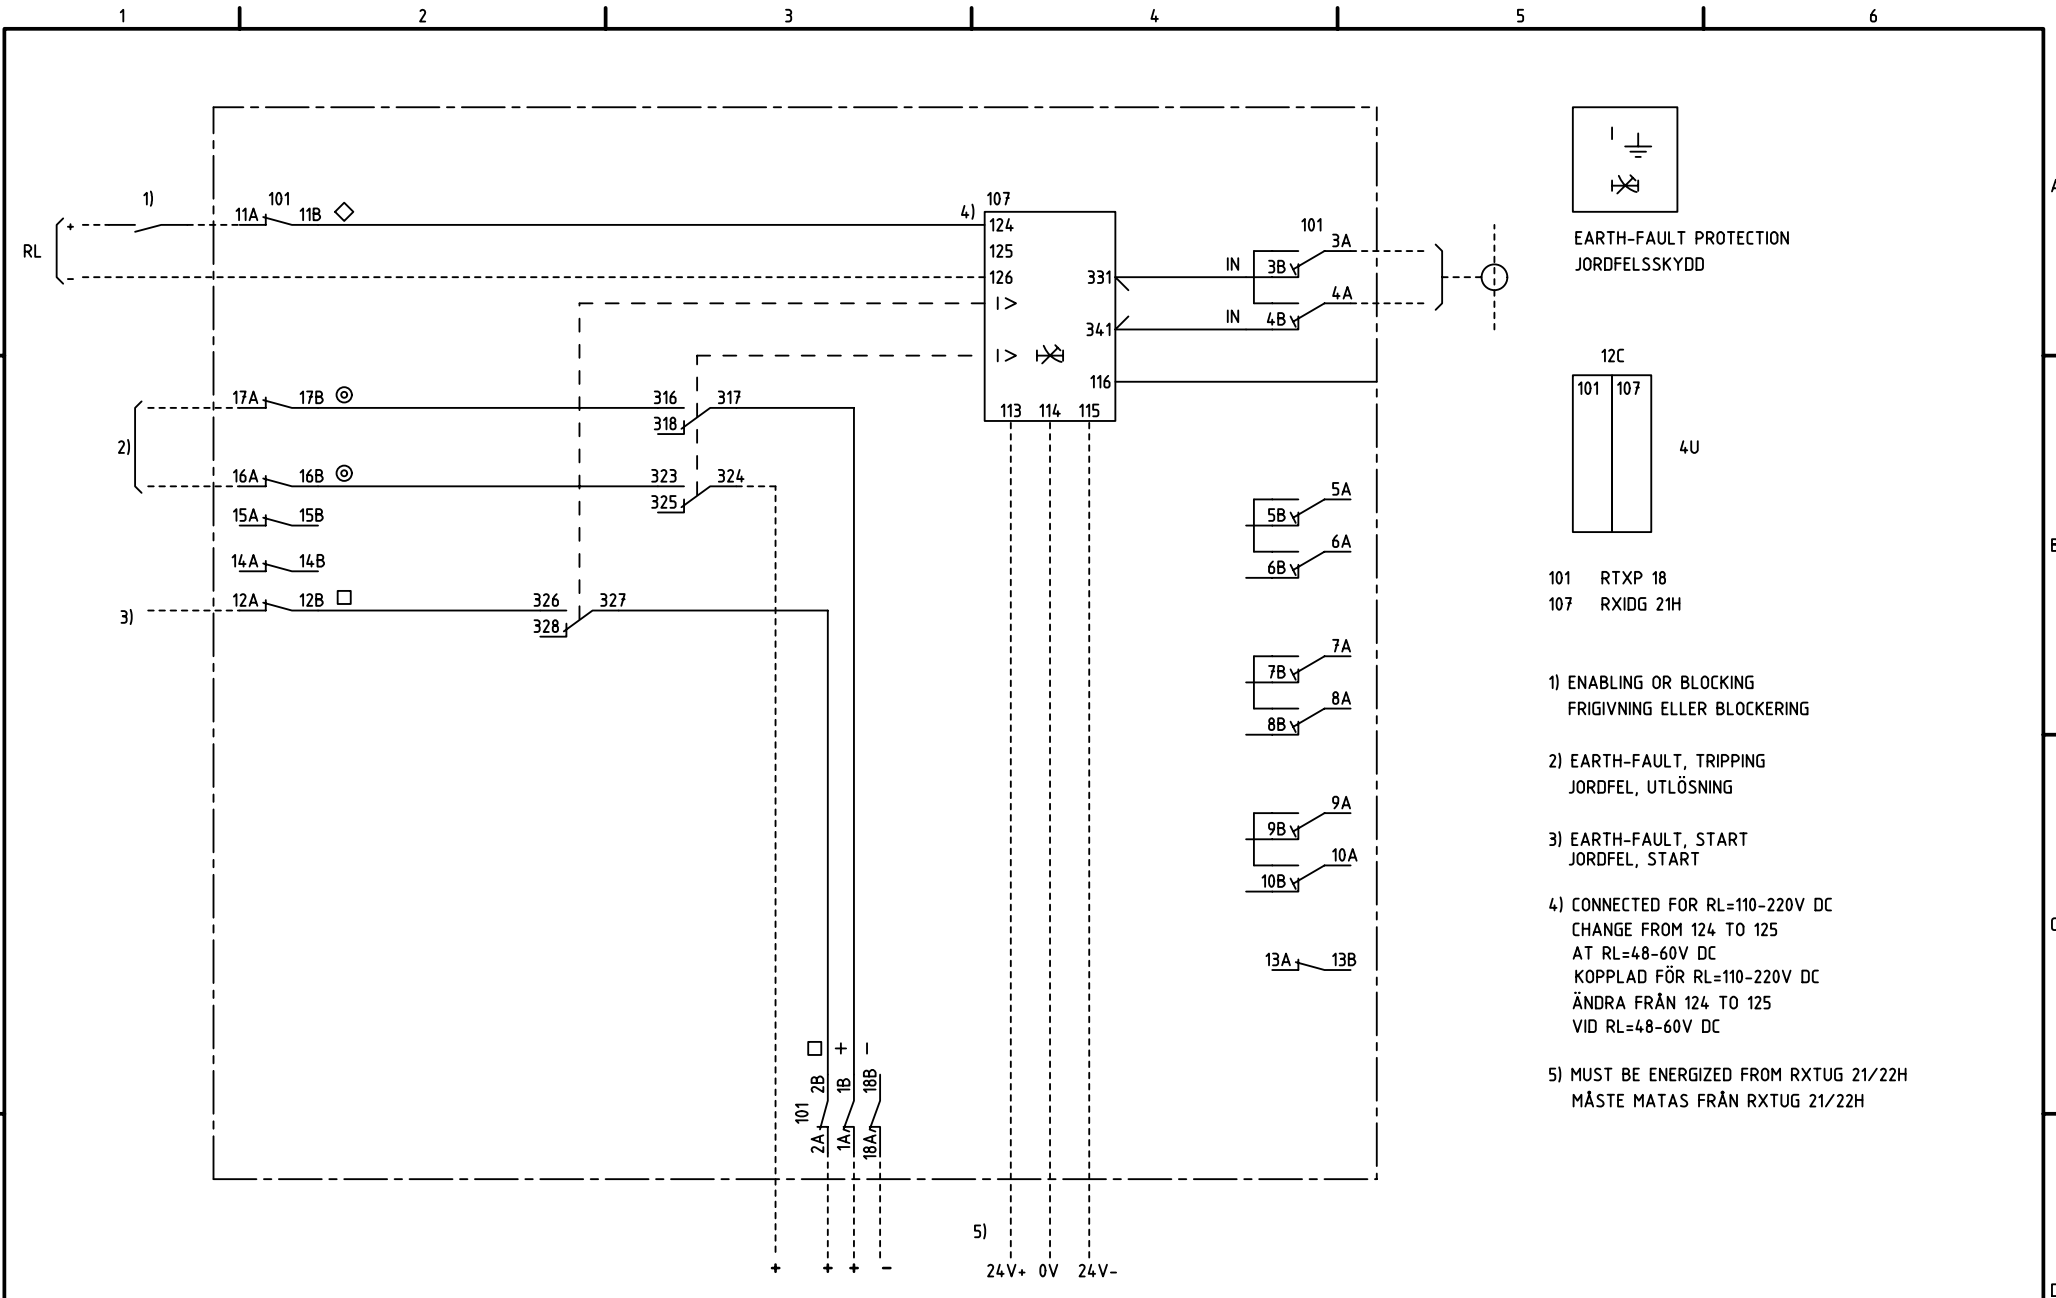

101 RTXP 18  
107 RXIDG 21H

- 1) ENABLING OR BLOCKING  
FRIGIVNING ELLER BLOCKERING
- 2) EARTH-FAULT, TRIPPING  
JORDFEL, UTLÖSNING
- 3) EARTH-FAULT, START  
JORDFEL, START
- 4) CONNECTED FOR RL=110-220V DC  
CHANGE FROM 124 TO 125  
AT RL=48-60V DC  
KOPPLAD FÖR RL=110-220V DC  
ÄNDRA FRÅN 124 TO 125  
VID RL=48-60V DC
- 5) MUST BE ENERGIZED FROM RXTUG 21/22H  
MÅSTE MATAS FRÅN RXTUG 21/22H

ELCAD ID PAT/render      DATE 2004-06-230:45 -      IMRK 001 006-BA      Issued in ARCADE

Prepared 96-10-08 H RAZA/LB		CIRCUIT DIAGRAM/KRETSSCHEMA		Resp dep PAT		Rev ind -		Lang 82	
Approved 96-11-28 P JENÅKER		RAIDG 1 EARTH-FAULT PROTECTION		Sheet 1		Cont		1	
Rev Ind		Revision		Reg No 7411		Pcl 890 475		<b>ABB</b> ABB Network Partner AB <b>IMRK 001 007-BA</b>	
Based on									