


We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

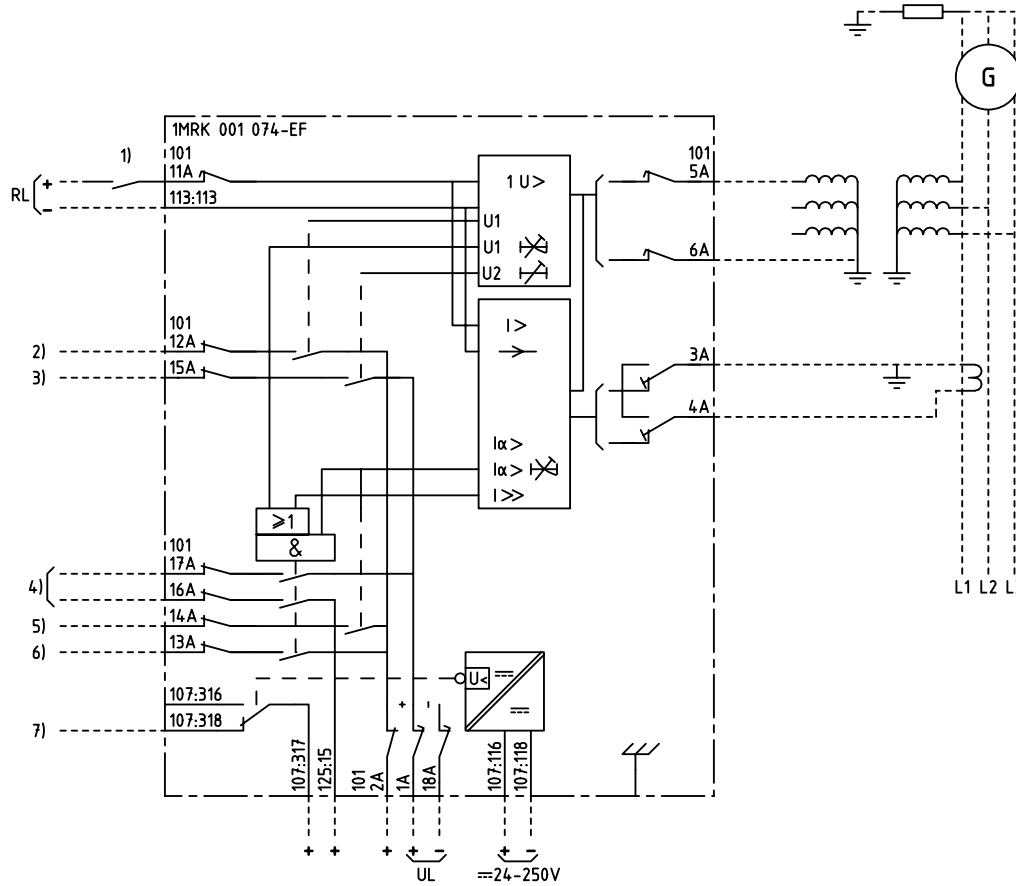

LOSS-OF-EXCITATION PROTECTION
UNDERMAGNETISERINGSSKYDD

- 1) RESETTING OF INDICATION
ÅTERSTÄLLNING AV INDIKERING
- 2) UNDERVOLTAGE STAGE 1, ALARM
UNDERSPÄNNING STEG 1, SIGNAL
- 3) OVER/UNDER VOLTAGE STAGE 2, TRIPPING
OVER/UNDERSPÄNNING STEG 2, UTLÖSNING
- 4) LOSS-OF-EXCITATION, TRIPPING ETC.
MAGNETISERINGSBORTFALL, UTLÖSNING M.M
- 5) UNDER EXCITATION, ALARM
UNDERMAGNETISERING, SIGNAL
- 6) LOSS-OF-EXCITATION, ALARM
MAGNETISERINGSBORTFALL, SIGNAL
- 7) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPPSPÄNNING

ELCAD ID PS/render

DATE 2004-06-223:34

Issued in ARCADE

Prepared 97-04-09 C-H EINVALL/JE		TERMINAL DIAGRAM/UTTAGSSCHEMA		Resp dep PS		Rev ind -		Lang 82	
Approved 97-04-23 P JENÄKER		RAGPK LOSS-OF-EXCITATION PROTECTION		RAGPK UNDERMAGNETISERINGSSKYDD				Sheet 1	
Rev Ind		Revision		Reg No 7411		Pcl 890.512		Cont	
Based on				ABB Network Partner AB		1MRK 001 074-EFA			

1

2

3

4

5

6