




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written permission of ABB Network Partner AB is strictly forbidden.

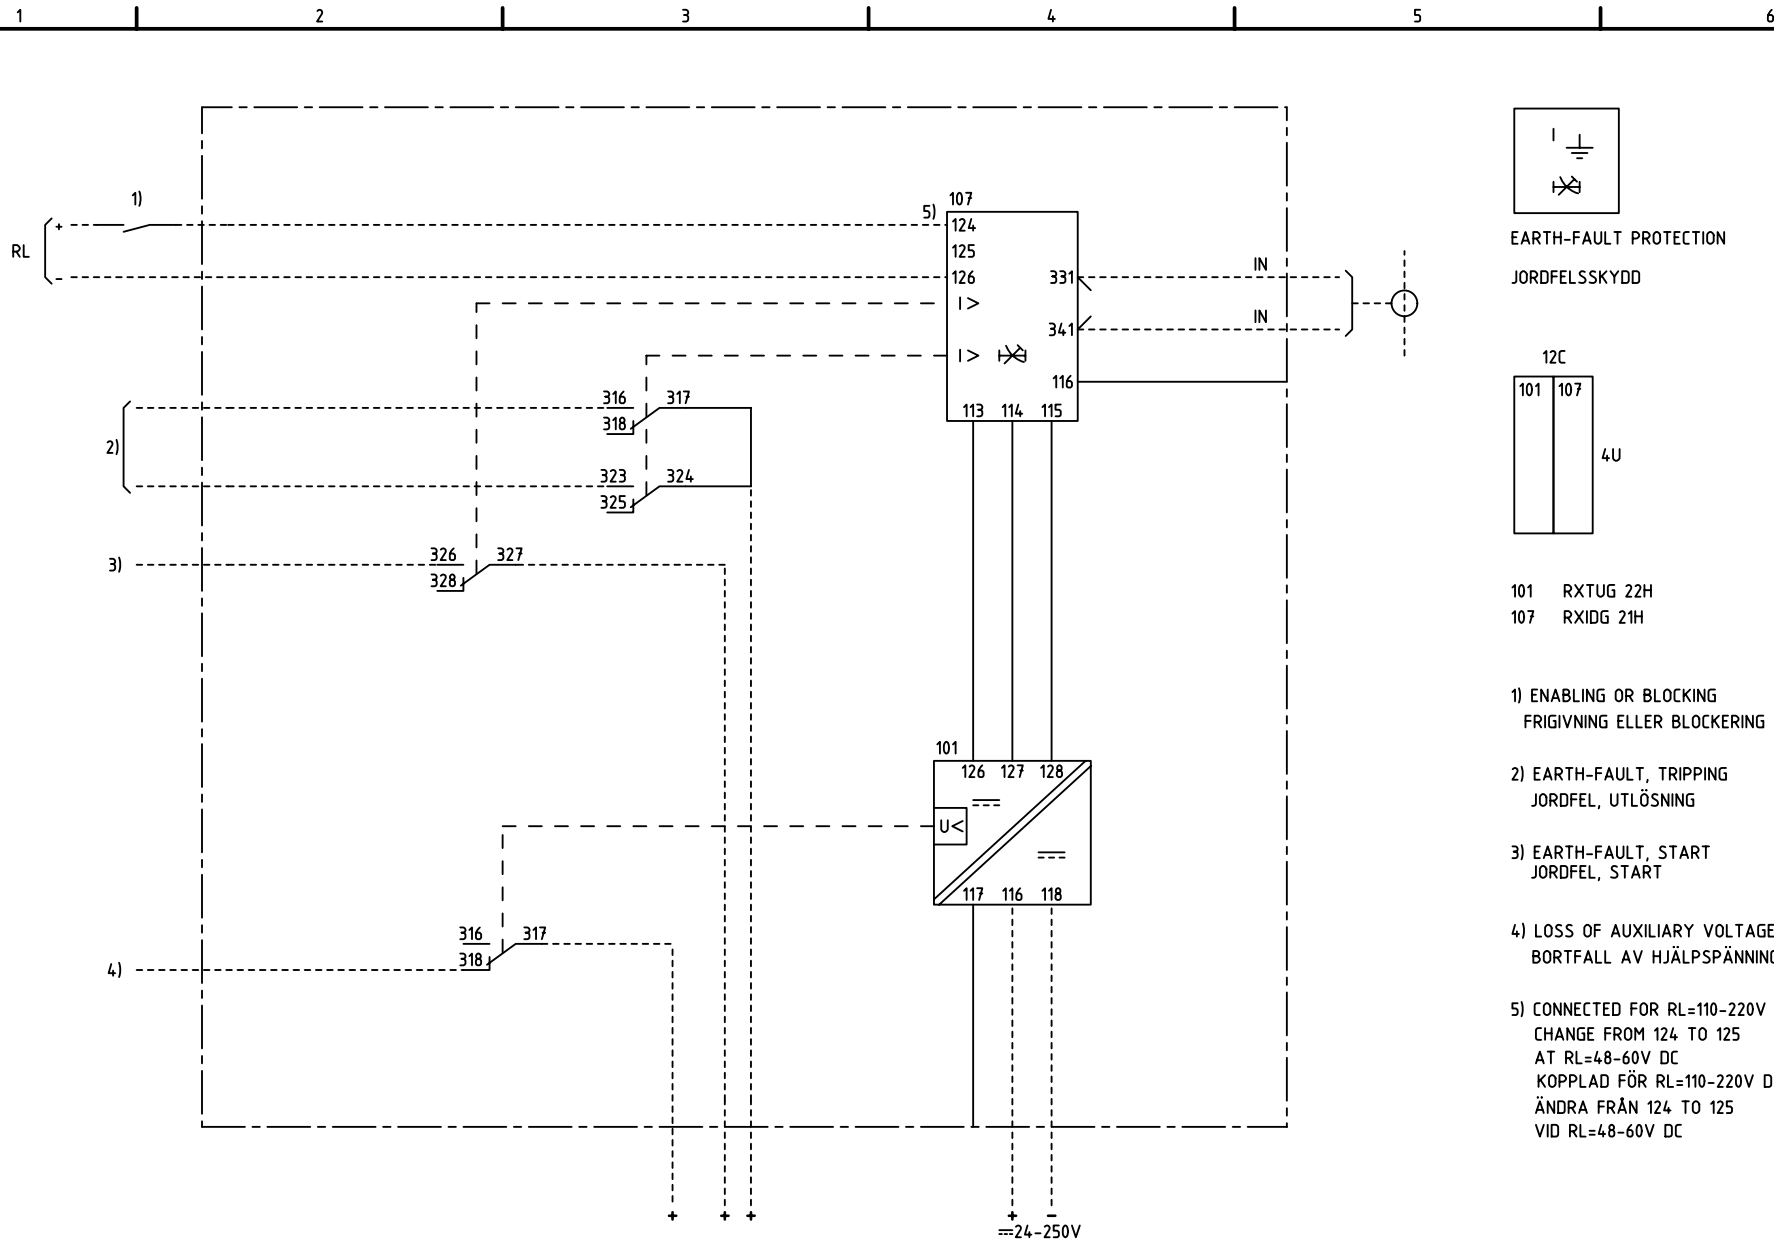

EARTH-FAULT PROTECTION
JORDFELSSKYDD



101 RXTUG 22H
107 RXIDG 21H

- 1) ENABLING OR BLOCKING
FRIGIVNING ELLER BLOCKERING
- 2) EARTH-FAULT, TRIPPING
JORDFEL, UTLÖSNING
- 3) EARTH-FAULT, START
JORDFEL, START
- 4) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING
- 5) CONNECTED FOR RL=110-220V DC
CHANGE FROM 124 TO 125
AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 124 TO 125
VID RL=48-60V DC

ELCAD ID PAT/render DATE 2004-06-230:29 - IMRK 001 006-DA Issued in ARCADE

		Prepared 96-03-29	HAIDER RAZA/L OLSTAM	CIRCUIT DIAGRAM/KRETSSCHEMA			
		Approved 96-05-13	P JENÄKER	RAIDIG 1 EARTH-FAULT PROTECTION			
				RAIDIG 1 JORDFELSSKYDD		Resp dep PAT	Rev ind -
Rev Ind	Revision	Reg No 7411			Lang 82		Sheet 1
Based on		Pcl 890 475			ABB ABB Network Partner AB		Cont

IMRK 001 007-CA