




We reserve all rights in this document and in the information contained therein. Reproduction, use for other purposes or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

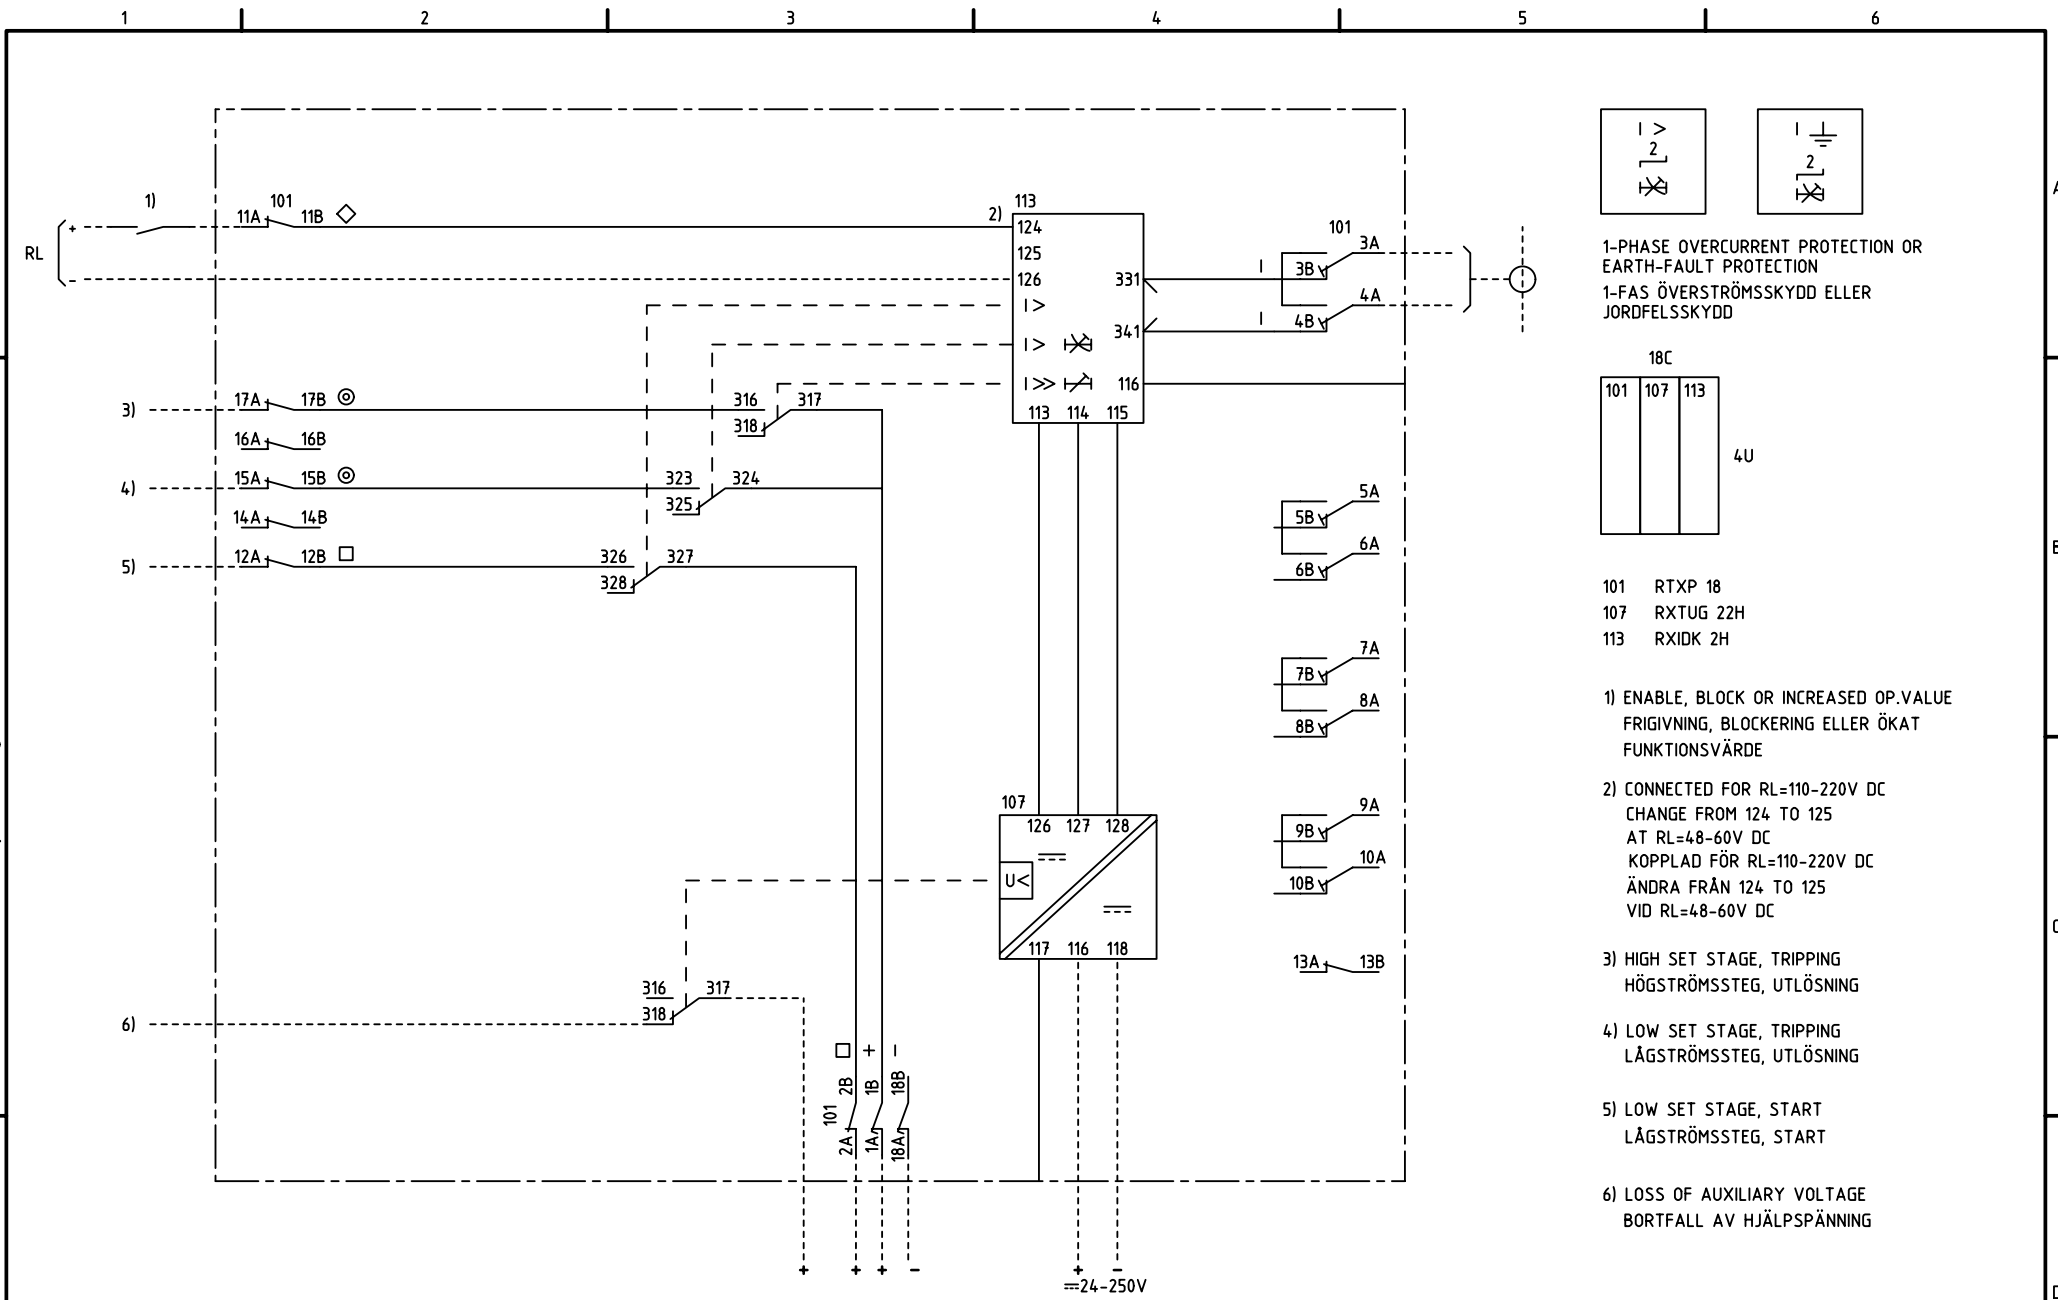

1-PHASE OVERCURRENT PROTECTION OR EARTH-FAULT PROTECTION
 1-FAS ÖVERSTRÖMSSKYDD ELLER JORDFELSSKYDD



101 RTXP 18
 107 RXTUG 22H
 113 RXIDK 2H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE FRIGIVNING, BLOCKERING ELLER ÖKAT FUNKTIONSVÄRDE
- 2) CONNECTED FOR RL=110-220V DC CHANGE FROM 124 TO 125 AT RL=48-60V DC KOPPLAD FÖR RL=110-220V DC ÄNDRA FRÅN 124 TO 125 VID RL=48-60V DC
- 3) HIGH SET STAGE, TRIPPING HÖGSTRÖMSSTEG, UTLÖSNING
- 4) LOW SET STAGE, TRIPPING LÅGSTRÖMSSTEG, UTLÖSNING
- 5) LOW SET STAGE, START LÅGSTRÖMSSTEG, START
- 6) LOSS OF AUXILIARY VOLTAGE BORTFALL AV HJÄLPSPÄNNING

ELCAD ID PAT/render DATE 2004-06-230:41 - 1MRK 001002-DA Issued in ARCADE

Prepared 96-01-17 HAIDER RAZA/L OLSTAM		CIRCUIT DIAGRAM/KRETSSCHEMA		Resp dep PAT		Rev ind -		Lang 82	
Approved 96-02-09 P JENÄKER		RAIDK 1 OVERCURRENT PROTECTION		ABB Network Partner AB		1MRK 001 003-DA		Sheet 1	
Rev Ind		Revision		Reg No 7411		Pct 890 474		Cont	