
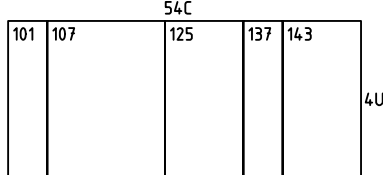


We reserve all rights in this document and in the information contained therein. Reproduction, use or distribution of this document without the written authority of ABB Automation Technologies AB is strictly forbidden.

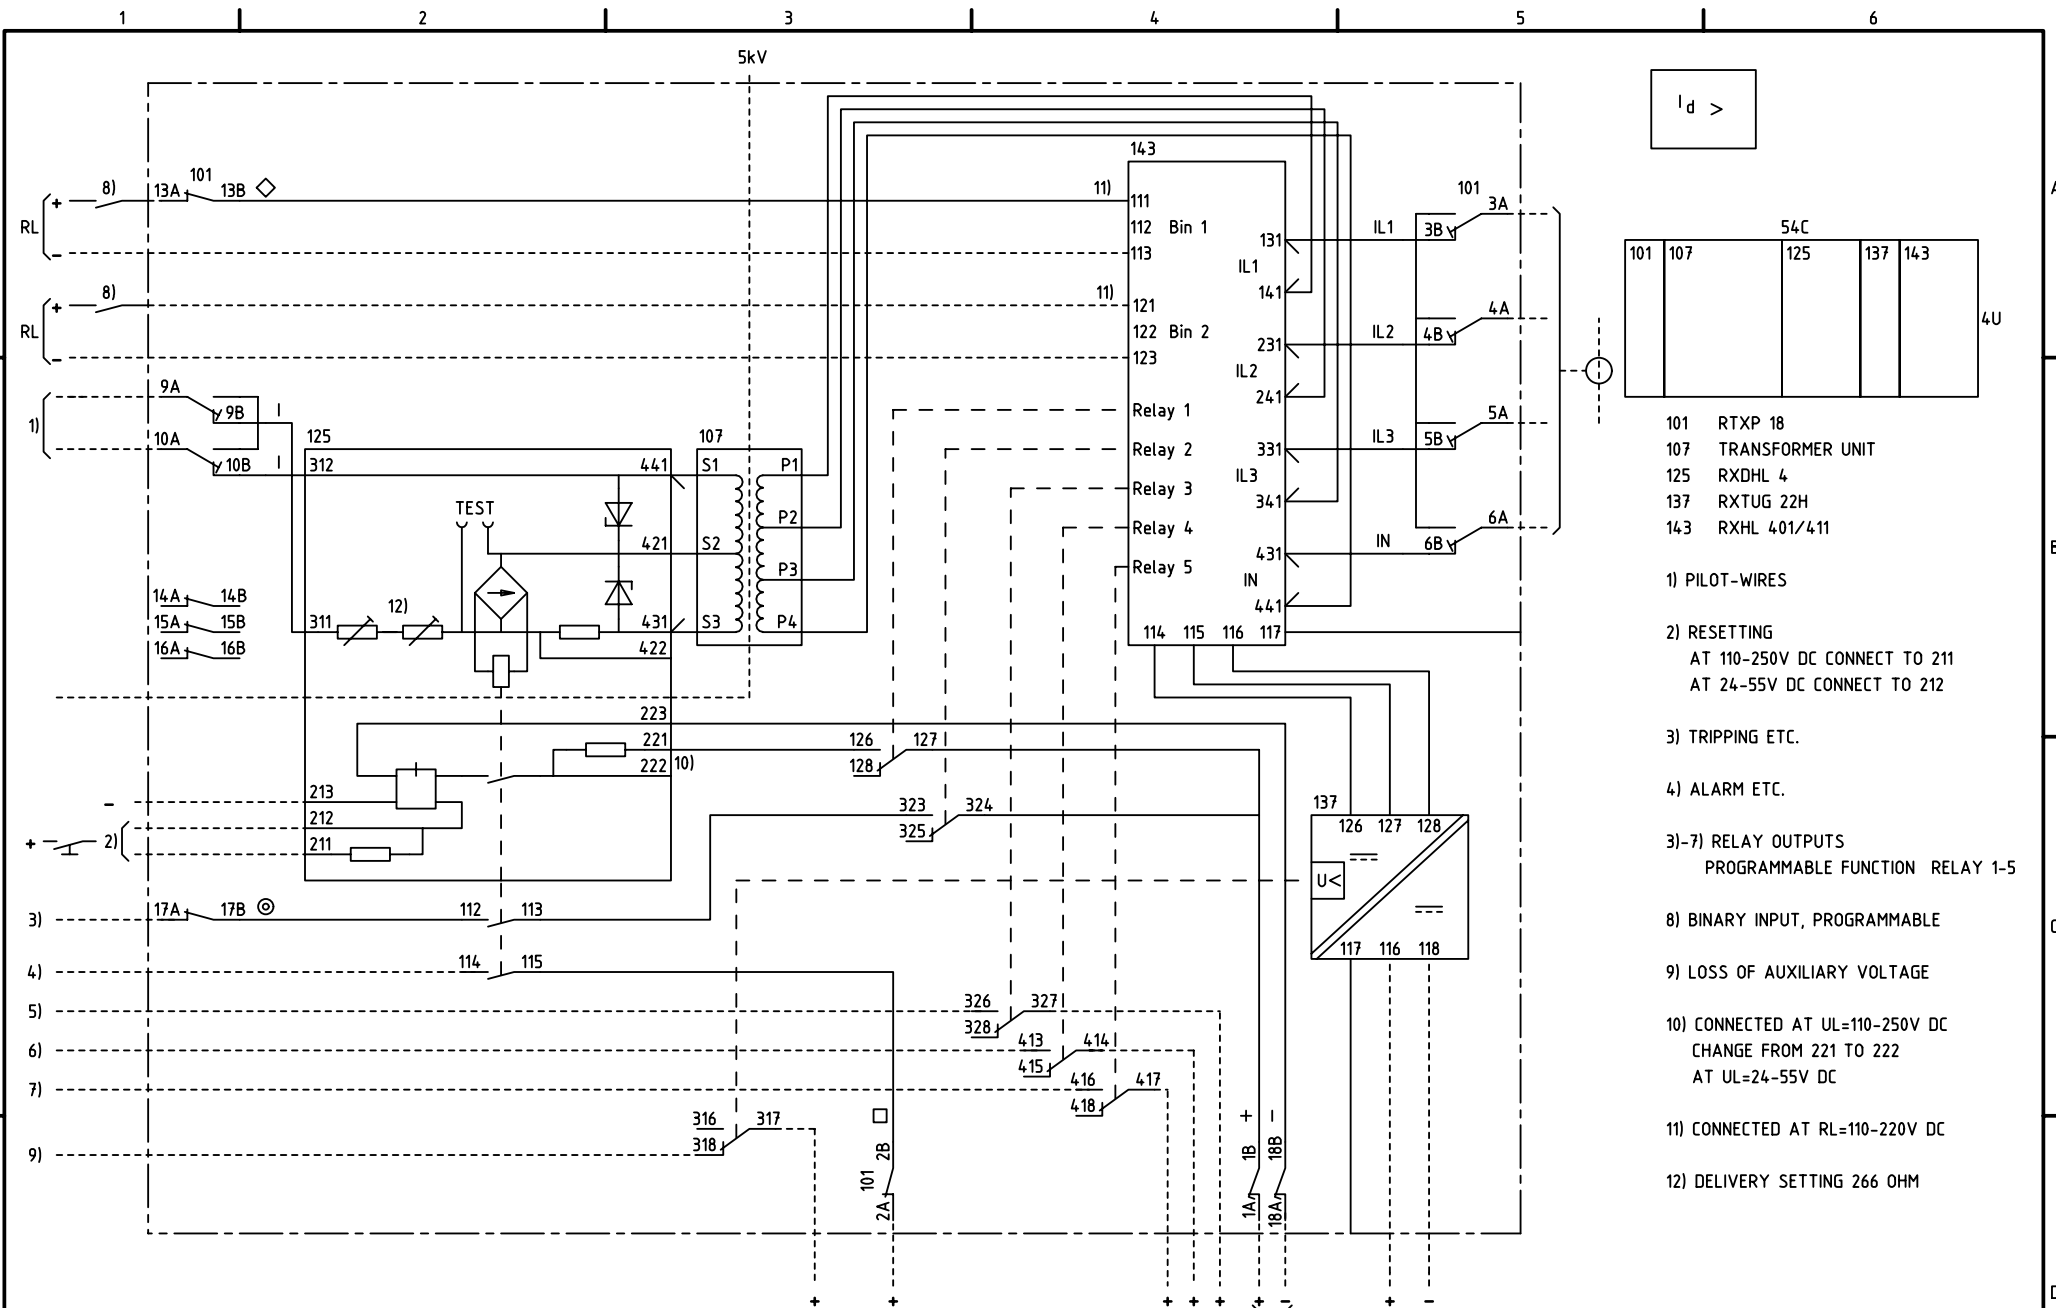

- 101 RTXP 18
  - 107 TRANSFORMER UNIT
  - 125 RXDHL 4
  - 137 RXTUG 22H
  - 143 RXHL 401/411
- 1) PILOT-WIRES
- 2) RESETTING  
AT 110-250V DC CONNECT TO 211  
AT 24-55V DC CONNECT TO 212
- 3) TRIPPING ETC.
- 4) ALARM ETC.
- 3)-7) RELAY OUTPUTS  
PROGRAMMABLE FUNCTION RELAY 1-5
- 8) BINARY INPUT, PROGRAMMABLE
- 9) LOSS OF AUXILIARY VOLTAGE
- 10) CONNECTED AT UL=110-250V DC  
CHANGE FROM 221 TO 222  
AT UL=24-55V DC
- 11) CONNECTED AT RL=110-220V DC
- 12) DELIVERY SETTING 266 OHM

Customer drw no	Prep. PTUA/ TPTD Eriksson Jill	2002-06-14	Circuit Diagram	Cont. sh/ No of sh
	Appr. PTUA/ SA/DP Jonsson Patrik	2003-04-15		
	Resp. dept PTUA/ TPTD		Document number	Lang.
Based on	ABB ABB Automation Technologies		1MRK002078-AA	en
			Rev.	Sheet
			-	1

Document status: Approved