




We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written consent of ABB Automation Technologies AB is strictly forbidden.

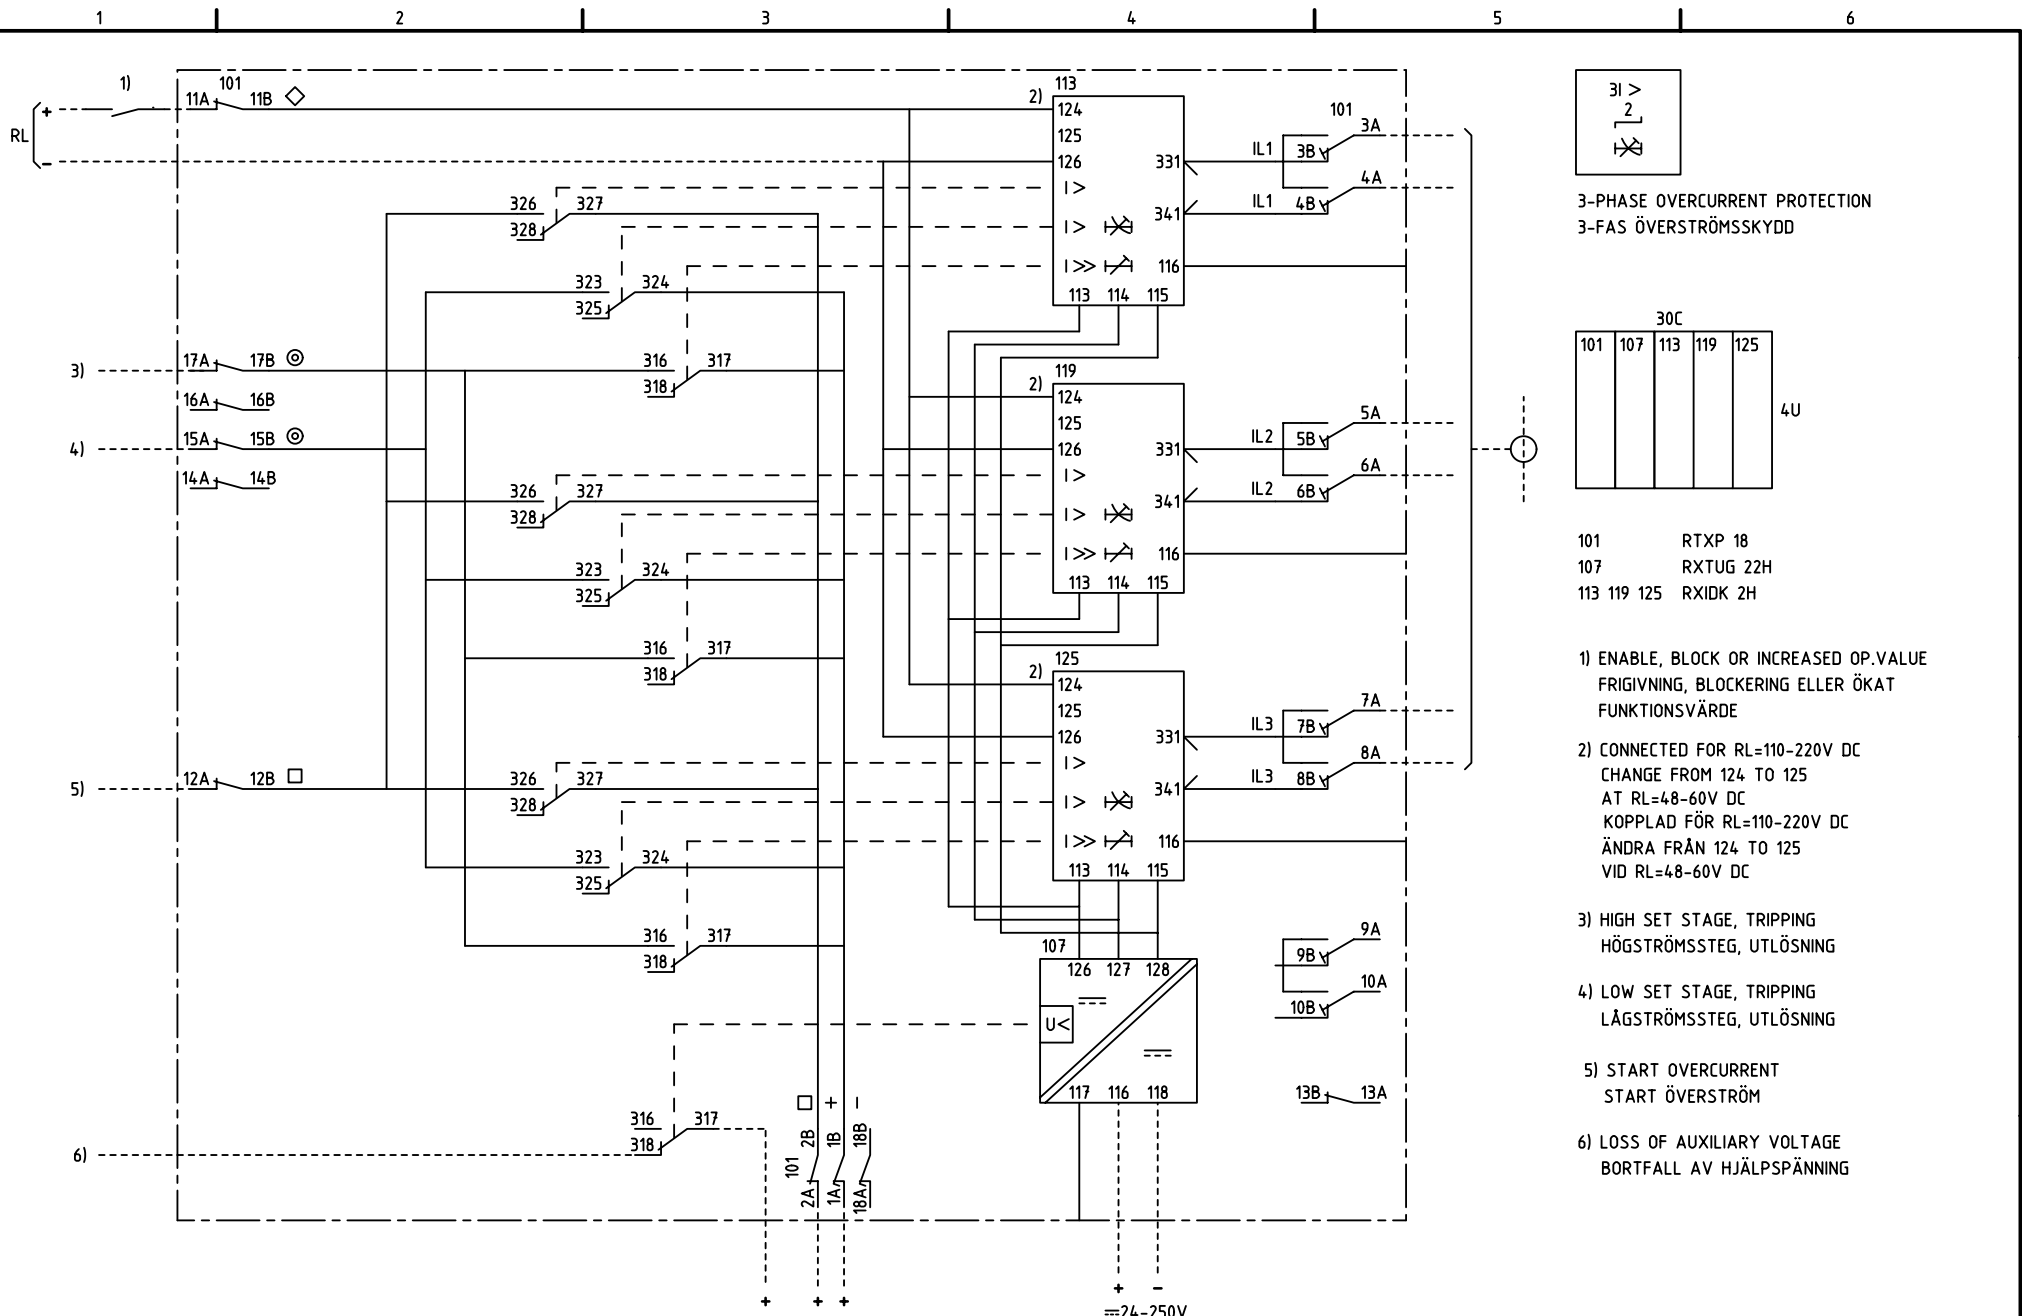

3-PHASE OVERCURRENT PROTECTION
3-FAS ÖVERSTRÖMSKYDD



101 RTXP 18
107 RXTUG 22H
113 119 125 RXIDK 2H

- 1) ENABLE, BLOCK OR INCREASED OP.VALUE
FRIGIVNING, BLOCKERING ELLER ÖKAT
FUNKTIONSVÄRDE
- 2) CONNECTED FOR RL=110-220V DC
CHANGE FROM 124 TO 125
AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 124 TO 125
VID RL=48-60V DC
- 3) HIGH SET STAGE, TRIPPING
HÖGSTRÖMSSTEG, UTLÖSNING
- 4) LOW SET STAGE, TRIPPING
LÅGSTRÖMSSTEG, UTLÖSNING
- 5) START OVERCURRENT
START ÖVERSTRÖM
- 6) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPSPÄNNING

Customer drw no	Prep. PTUA/ TPTD Eriksson Jill 2000-10-18	Circuit Diagram RAIDK 3 OVERCURRENT PROTECTION	Conf. sh/ No of sh
	Appr. PTUA/ TATD Karlsson Roger 2000-10-24		
	Resp. dept PTUA/ TPTD	Document number 1MRK001003-PA	Lang. 82
Based on	ABB ABB Automation Technologies	Rev. A	Sheet 1

Document status: Approved