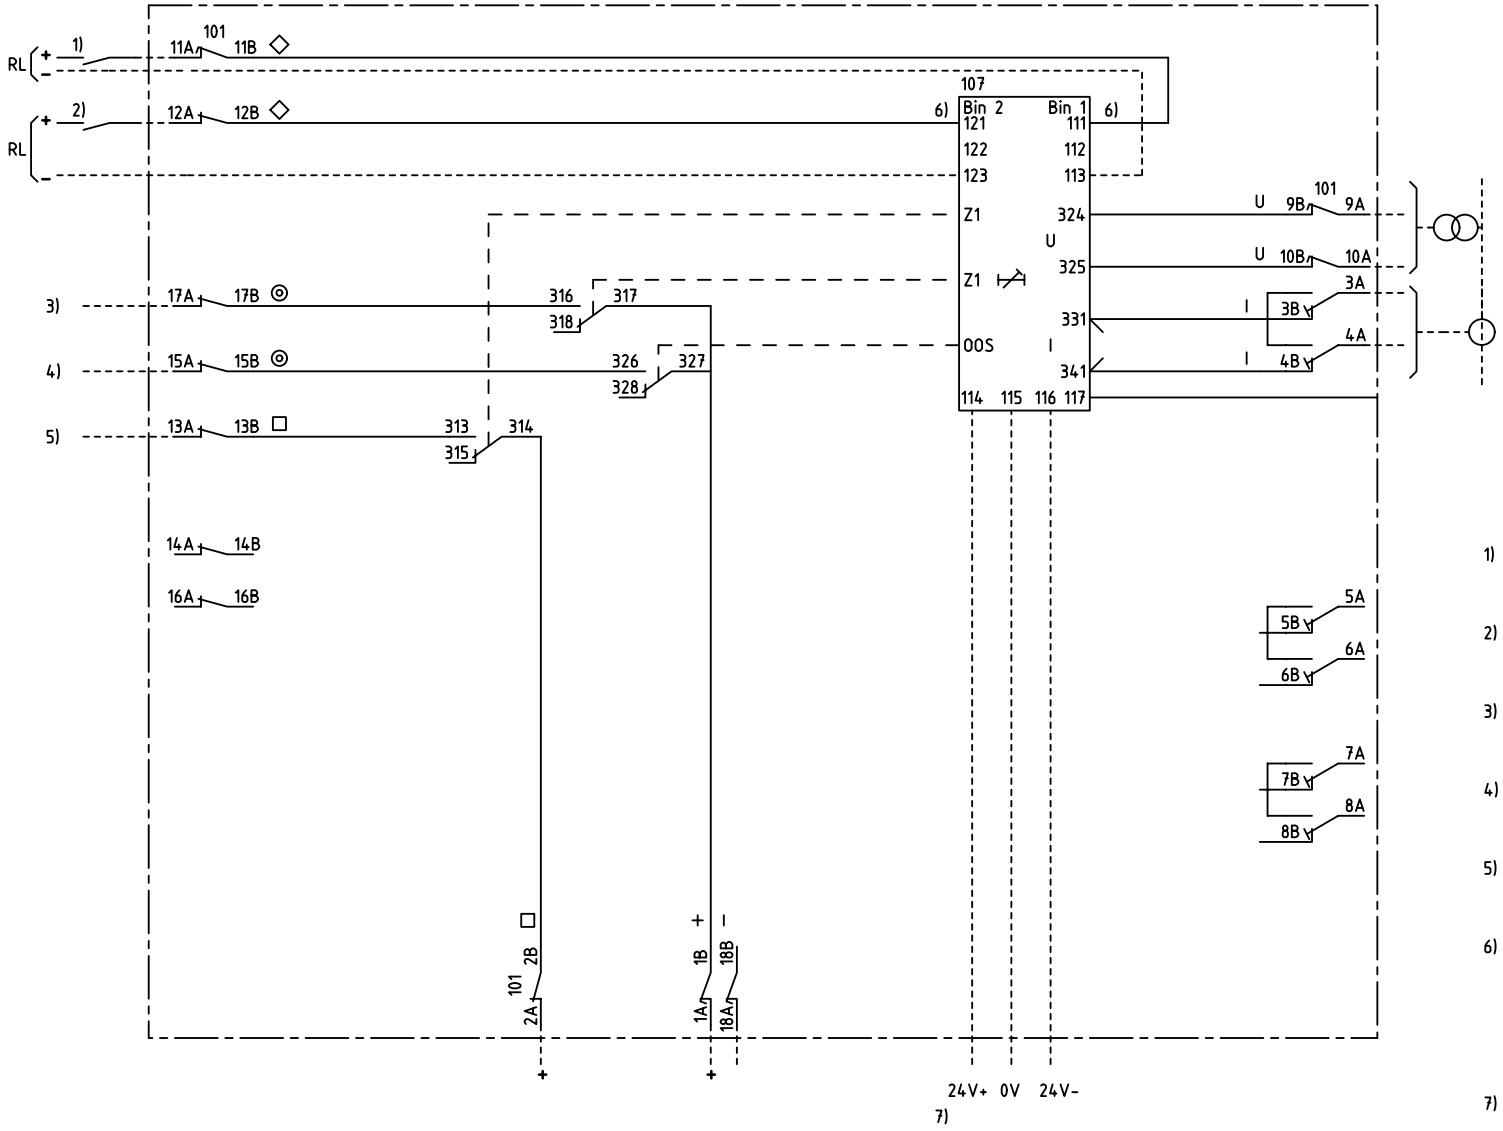



1-PH UNDERIMPEDANCE PROTECTION
DELAYED
1-FAS UNDERIMPEDANDSSKYDD
FÖRDRÖJT



101 RTXP 18
107 RXZK 23H

1) TOTAL BLOCKING
TOTAL BLOCKERING

2) RESETTING OF INDICATION
ÅTERSTÄLLNING AV INDIKERING

3) UNDERIMPEDANCE, TRIPPING
UNDERIMPEDANS, UTLÖSNING

4) OUT OF STEP, TRIPPING
URFASFALL, UTLÖSNING

5) UNDERIMPEDANCE, START
UNDERIMPEDANS, START

6) CONNECTED FOR RL=110-220V DC
CHANGE FROM 111 TO 112 AND
121 TO 122 AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 111 TILL 112 OCH
121 TILL 122 VID RL=48-60V DC

7) MUST BE ENERGIZED FROM RXTUG 21/22H
MÅSTE MATAS FRÅN RXTUG 21/22H

We reserve all rigths in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. © ABB Network Partner AB

ELCAD ID PS/render DATE 2004-06-221:14 1MRK 001 067-BA Issued in ARCADE

Prepared	97-01-09	C-H Einvall/L Bergman	CIRCUIT DIAGRAM/KRETSSCHEMA
Approved	97-01-29	P Jenåker	RAZK 231 1-PHASE UNDERIMPEDANCE PROT.
			RAZK 231 1-FAS UNDERIMPEDANSSKYDD

Rev Ind | Revision | Reg No 7411
Based on | Pcl 890.557

ABB Network Partner AB

Resp dep PS | Rev Ind 1 97.27 | Lang 82

1MRK 001 068-BA

Sheet 1 | Cont