



We reserve all rights in this document and in the information contained therein. Reproduction, use for other than intended purposes, or distribution without the written consent of ABB Network Partner AB is strictly forbidden.

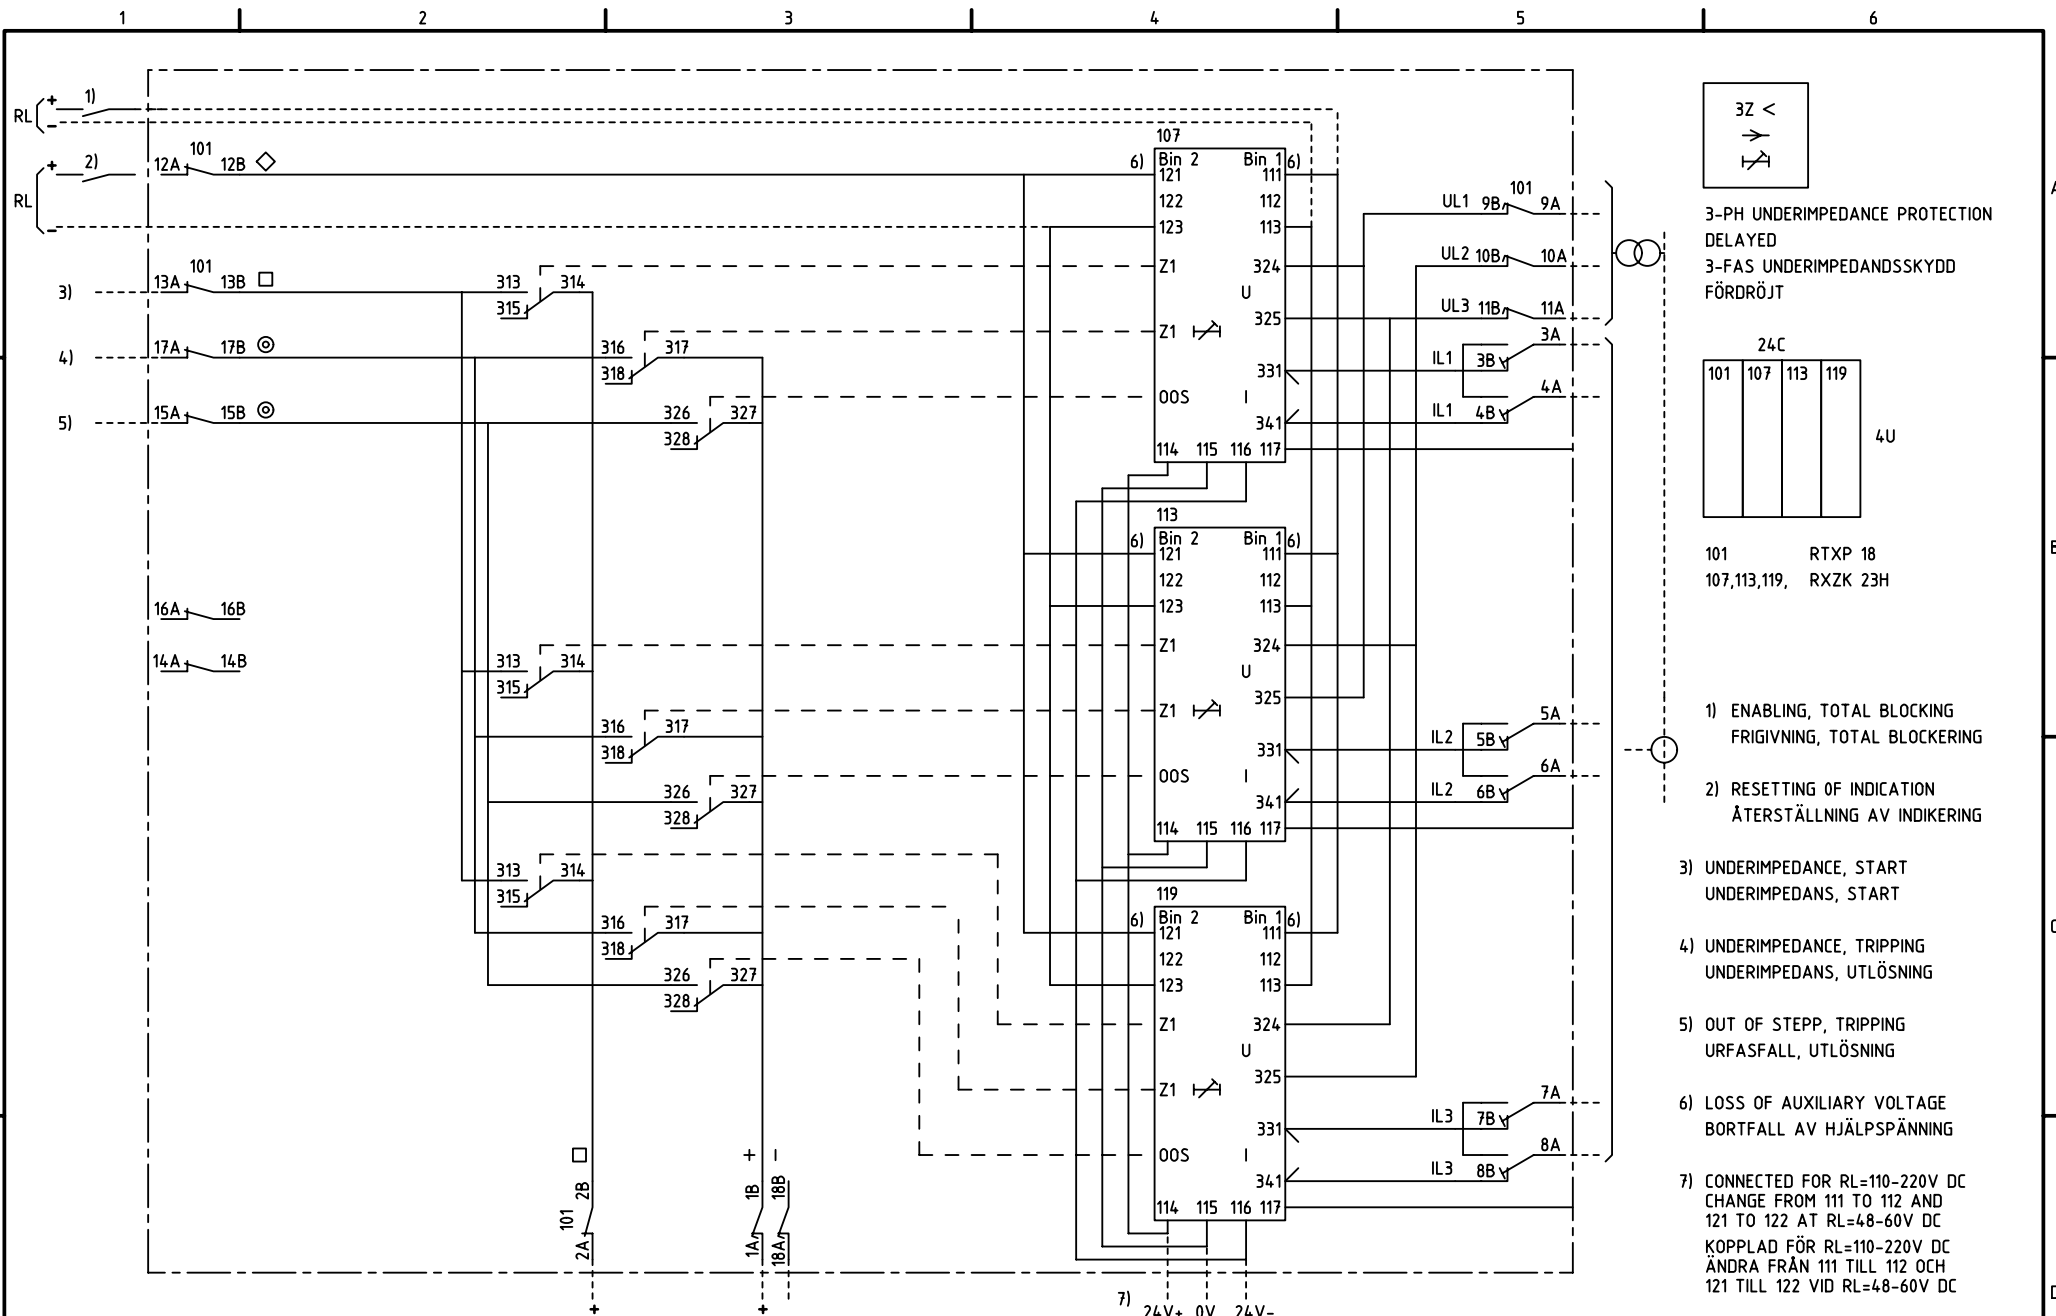

3-PH UNDERIMPEDANCE PROTECTION
DELAYED
3-FAS UNDERIMPEDANSSKYDD
FÖRDRÖJT

24C			
101	107	113	119
4U			

101 RTXP 18
107,113,119, RXZK 23H

- 1) ENABLING, TOTAL BLOCKING
FRIGIVNING, TOTAL BLOCKERING
- 2) RESETTING OF INDICATION
ÅTERSTÄLLNING AV INDIKERING
- 3) UNDERIMPEDANCE, START
UNDERIMPEDANS, START
- 4) UNDERIMPEDANCE, TRIPPING
UNDERIMPEDANS, UTLÖSNING
- 5) OUT OF STEPP, TRIPPING
URFASFALL, UTLÖSNING
- 6) LOSS OF AUXILIARY VOLTAGE
BORTFALL AV HJÄLPPSPÄNNING
- 7) CONNECTED FOR RL=110-220V DC
CHANGE FROM 111 TO 112 AND
121 TO 122 AT RL=48-60V DC
KOPPLAD FÖR RL=110-220V DC
ÄNDRA FRÅN 111 TILL 112 OCH
121 TILL 122 VID RL=48-60V DC

ELCAD ID PS/render DATE 2004-06-230:49 1MRK 001 067-NA Issued in ARCADE

Prepared 97-01-09 H Raza/L Bergman		CIRCUIT DIAGRAM/KRETSSCHEMA		Issued in ARCADE	
Approved 97-01-29 P Jenåker		RAZK 233 3-PHASE UNDERIMPEDANCE PROT.		Resp dep PS Rev ind 1 9724 Lang 82	
Rev Ind Revision Reg No 7411		RAZK 233 3-FAS UNDERIMPEDANSSKYDD		Sheet 1	
Based on Pcl 890.557		ABB ABB Network Partner AB		Cont	